

**1993 Edition
Effective April 1, 1994
Amendments
Effective Aug. 1, 1996**



**Virginia
Statewide Fire
Prevention Code**

**Virginia
Uniform Statewide
Building Code
VOLUME II**

DIVISION I

**1993 EDITION
VIRGINIA STATEWIDE FIRE PREVENTION CODE.**

**13 VAC 5-50-10 et seq.
(Formerly VR 394-01-6)**

EFFECTIVE APRIL 1, 1994



DIVISION II

**1993 EDITION
VIRGINIA UNIFORM STATEWIDE BUILDING CODE,
VOLUME II - BUILDING MAINTENANCE CODE.**

**13 VAC 5-70-10 et seq.
(Formerly VR 394-01-22)**

**EFFECTIVE APRIL 1, 1994
AMMENDMENTS EFFECTIVE AUGUST 1. 1996**

Copyright 1994

**Department of Housing and Community Development
Division of Building and Fire Regulation
501 North Second Street
Richmond, Virginia 23219-1321**

PREFACE

The Code of Virginia directs the Board of Housing and Community Development (BHCD) to adopt and promulgate a Statewide Fire Prevention Code. This is in addition to the authority given to promulgate a building maintenance code.

The Statewide Fire Prevention Code (SFPC) is a mandatory set of regulations designed to provide statewide standards to safeguard life and property from conditions which are liable to cause or contribute to the spread of fire; the hazards of fire or explosion arising from the improper maintenance of life safety, fire prevention and protection materials, devices, systems, and the unsafe storage, handling and use of explosives, substances, materials, and devices.

The Uniform Statewide Building Code, Volume II, Building Maintenance Code (USBC, Vol. II) provides mandatory, statewide, uniform regulations to protect occupants of all existing buildings and structures from health and safety hazards arising from the improper maintenance or use of buildings and structures.

Local governments are authorized to adopt fire prevention regulations that are more restrictive or extensive in scope than the SFPC provided such local regulations do not affect the manner of construction, or the materials to be used in the erection, alteration, repair, or use of a building or structure. Any provision of the SFPC which is in conflict with the Uniform Statewide Building Code, Volume I - New Construction Code, or USBC Vol. II, or any other applicable laws of the Commonwealth, is invalid.

Any local government may enforce the USBC, Vol. II, as a whole or any portion of the code, and may assign the responsibility to a local agency of its choice. Local government has not been given the authority to amend the USBC, Vol. II.

Enforcement of the SFPC by local government is optional. The State Fire Marshal is authorized to enforce the SFPC in those jurisdictions in which the local government does not enforce the SFPC.

The SFPC and USBC, Vol. II contain enforcement procedures that must be used by the enforcing agency. An administrative appeals system is established to resolve any disagreements that may occur between the enforcing agency and the aggrieved party.

USE OF NATIONALLY RECOGNIZED MODEL CODES AND STANDARDS

The BHCD bases the technical requirements of the SFPC and USBC, Vol. II on nationally accepted model codes and standards. It makes as few amendments as possible. The purpose is to benefit the citizens of Virginia by promoting efficiency in the fire safety field, and in the building industry, many aspects of which are interstate in nature. For this reason, the BHCD encourages anyone who believes that a technical amendment is needed to submit their proposal directly to the model code or standard organization. Amendments made by such organizations will then be considered for inclusion in future editions of the SFPC and USBC, Vol. II. Information on how to present proposals to the model code and standard organizations is available, see Appendix F.

FUTURE EDITIONS

State law requires the BHCD to keep the USBC, Vol II. and SFPC up-to-date. The BHCD plans to do this by updating the codes every three years when new editions of the model codes become publicly available. Suggestions for improvements are invited at any time and should be directed to the State Building Code Office.

USER ASSISTANCE

The local government should be consulted first for information and assistance regarding the SFPC and USBC, Vol. II. If they are not enforcing the codes, the State Fire Marshal may be contacted. Copies of the model codes and standards referenced by the SFPC and USBC, Vol. II are available for public inspection at any office of the State Fire Marshal and may be purchased through:

Building Officials and Code Administrators, International, Inc.
4051 West Flossmoor Road
Country Club Hills, Illinois 60478-5795
(312) 799-2300
Fax (312) 799-4981

You may also contact the regional State Fire Marshal's Office in your area.

Northern Regional Office
Suite 22, SPR Building
70 Main Street
Warrenton, Virginia 22186
(540) 347-6351
(540) 347-6377

Southwest Regional Office
200 West Hull Building
554 South Main Street
Marion, Virginia 24354
(540) 783-3461
Fax (540) 783-4132

Tidewater Regional Office
Suite 223, Bldg. No. 5
Koger Executive Center
Norfolk, Virginia 23501
(757) 455-3820
Fax (757) 455-3844

Central Region Office
Second Floor, Jackson Center
501 North 2nd Street
Richmond, Virginia 23219
(804) 371-7153
Fax (804) 371-7092

Western Regional Office
Commonwealth Bldg. Ste.B40
212 Church Avenue, S.W.
Roanoke, Virginia
(540) 857-7362
Fax (540) 857-7362

NOTE TO CODE USERS

A broken vertical line in the margins of some pages indicates amendments effective August 1, 1996. For information on previous USBC, Vol. I editions and amendments, see Appendix C.

TABLE OF CONTENTS.

DIVISION I.

**VIRGINIA STATEWIDE FIRE
PREVENTION CODE.**

**CHAPTER 1.
ADMINISTRATION.**

F-100.0 General	1
F-101.0 Referenced Standards and Amendments	2
F-102.0 Enforcement Authority	2
F-103.0 Duties and Powers of the Fire Official	4
F-104.0 Permits	4
F-105.0 Appeals	5
F-106.0 Unsafe Conditions	7

ADDENDUM

Amendments to the BOCA National Fire Prevention Code/1993 Edition	9
--	---

DIVISION II.

**VIRGINIA UNIFORM STATEWIDE
BUILDING CODE,
VOLUME II - BUILDING MAINTENANCE
CODE.**

**CHAPTER 1.
ADMINISTRATION.**

100.0 General	22
101.0 Requirements	23
102.0 Local Enforcing Agency	23
103.0 Duties and Powers of the Code Official	25
104.0 Violations	26
105.0 Unsafe Buildings	26
106.0 Appeals	27
107.0 Demolition of Buildings	29
108.0 Special Provisions	29

ADDENDUM

Amendments to the BOCA National Property Maintenance Code/1993 Edition ..	31
--	----

APPENDIXES

A. Related Laws	33
B. Blaster Certification Regulation	51
C. Previous USBC Adoptions and Amendments	52
D. Board of Housing and Community Development	57
E. State Building Code Technical Review Board	57
F. Forms Available	58

DIVISION I.

VIRGINIA STATEWIDE FIRE PREVENTION CODE.

CHAPTER 1. ADMINISTRATION.

SECTION F-100.0 GENERAL.

F-100.1. Title. These regulations shall be known as the Virginia Statewide Fire Prevention Code (SFPC). Except as otherwise indicated, SFPC or code, shall mean the 1993 edition of the Virginia Statewide Fire Prevention Code.

F-100.2. Authority. The SFPC is adopted according to regulatory authority granted the Board of Housing and Community Development (BHCD) by the Statewide Fire Prevention Code Act, Chapter 9, Title 27, §§ 27-94 through 27-101 of the Code of Virginia.

F-100.3. Adoption. The SFPC was adopted by order of the Board of Housing and Community Development on December 13, 1993. This order was prepared according to the requirements of the Administrative Process Act. The order is maintained as part of the records of the Department of Housing and Community Development (DHCD), and is available for public inspection.

F-100.4. Effective date. The SFPC shall become effective on April 1, 1994.

F-100.5. Effect on other codes. The SFPC shall apply to all buildings and structures as defined in the Uniform Statewide Building Code Law, Chapter 6, Title 36, Code of Virginia. The SFPC shall supersede the fire prevention regulations previously adopted by local government or other political subdivisions. When any provision of this code is found to be in conflict with the Uniform Statewide Building Code (USBC), OSHA, or applicable laws of the Commonwealth, that provision of the SFPC shall become invalid. Wherever the words "building code" appear they shall mean the building code in effect at the time of construction.

F-100.6. Purpose. The purpose of the SFPC is to provide statewide standards for optional local enforcement to safeguard life and property from the hazards of fire or explosion arising from the improper maintenance of life safety and fire prevention and protection materials, devices, systems and structures, and the unsafe storage, handling and use of substances, materials and devices, including explosives and blasting agents, wherever located.

F-100.7. Application to post-Uniform Statewide Building Code (USBC) buildings. Egress facilities, fire protection, built-in fire protection equipment, and other fire safety features in such buildings shall be maintained in accordance with the requirements of the USBC in effect at the time the building or structure was constructed.

F-100.8. Application to pre-Uniform Statewide Building Code (USBC) buildings. Pre-USBC buildings are those buildings that were not subject to the USBC when constructed. Such buildings shall be maintained in accordance with the Virginia Public Building Safety Regulations (VR 394-01-05) which are hereby incorporated into this code by reference, and other applicable requirements of this code.

Note: The Virginia Public Building Safety Regulations (VR 394-01-05), are available from the Training and Certification Office (DHCD), 501 North Second Street, Richmond, VA 23219-1321.

F-100.9. Special provisions. The fire official shall require that buildings subject to the requirements of Section 108.0 of the Uniform Statewide Building Code, Volume II - Building Maintenance Code, 1993 Edition, comply with the provisions of that section.

Exception: Family day homes as defined in § 63.1-195 of the Code of Virginia shall be

exempt from this provision.

F-100.10. Exemptions for farm structures. Farm structures not used for residential purposes shall be exempt from the provisions of the SFPC.

SECTION F-101.0. REFERENCED STANDARDS AND AMENDMENTS.

F-101.1. Adoption of model code. The following model code, as amended by Sections F-101.2 and F-101.3, is hereby adopted and incorporated in the SFPC.

The BOCA National Fire Prevention Code/1993 Edition, published by: Building Officials and Code Administrators International, Inc., 4051 West Flossmoor Road, Country Club Hills, IL 60477.

F-101.2. Administrative and enforcement amendments to the referenced model code. All requirements of the referenced model code and standards that relate to administrative and enforcement matters are deleted and replaced by Chapter 1 of the SFPC.

F-101.3. Other amendments to the referenced model code. The amendments noted in Addendum 1 shall be made to the specified articles and sections of the BOCA National Fire Prevention Code/1993 Edition.

F-101.4. Limitation of application of model code. No provision of the model code shall affect the manner of construction, or materials to be used in the erection, alteration, repair, or use of a building or structure.

SECTION F-102.0. ENFORCEMENT AUTHORITY.

F-102.1. Enforcement. Any local government may enforce the SFPC after official action. The local governing body may assign responsibility for enforcement of the SFPC to the local agency or agencies of its choice. The State Fire Marshal shall have authority to enforce the SFPC in jurisdictions in which the local governments do

not enforce the code. The State Fire Marshal's office shall be notified by the local government in writing when the fire official has been appointed and shall provide a copy of the resolution or ordinance adopting the enforcement provisions of the SFPC. The terms "enforcing agency" and "fire official" apply to the agency or agencies responsible for enforcement. The terms "building official" or "building department" apply only to the local building official or building department.

F-102.1.1. Modifications. The fire official may grant modifications to any provisions of the Statewide Fire Prevention Code upon application of the owner or the owner's representative, provided that the spirit and intent of the code is observed and public health, welfare and safety are assured.

F-102.1.1.1. Records. The application for modification and the final decision of the fire official shall be in writing and shall be officially recorded.

F-102.2. Alternative methods and materials. The provisions of this code are not intended to prevent the use of any material or method of work not specifically prescribed by this code, provided that such alternative shall comply with the intent of the provisions of this code. The material, method or work offered shall be, for the purpose intended, at least the equivalent of that prescribed in this code in quality, strength, effectiveness, fire resistance, durability and safety.

F-102.2.1. Supporting data. The fire official shall require that sufficient technical data be submitted to substantiate the proposed use of any material or assembly. If it is determined that the evidence presented is satisfactory proof of performance for the use intended, the fire official shall approve the use of such alternative subject to the requirements of this code. Supporting data, when required by the fire official to assist in the approval of all materials or assemblies not specifically provided for in this code, shall

consist of duly authenticated research reports from approved sources.

F-102.3. Qualifications and certification of fire officials and technical assistants. Fire officials and technical assistants shall meet the standards set forth in Sections F-102.3.1 and F-102.3.2.

F-102.3.1. Certification of fire official. The fire official shall be certified in accordance with the Virginia Certification Standards (13 VAC 5-20-10 et seq.) within three years after date of employment.

Exception: An individual employed as the fire official in a locality in Virginia prior to April 1, 1994 shall be exempt from certification while employed as the fire official in that jurisdiction. This exemption shall not apply to subsequent employment as the fire official in another jurisdiction.

F-102.3.2 Certification of technical assistants. The technical assistants shall be certified in accordance with the Virginia Certification Standards (13 VAC 5-20-10 et seq.) within three years after date of employment.

Exceptions: 1. An individual employed as a technical assistant in a locality in Virginia prior to April 1, 1994 shall be exempt from certification while employed as the technical assistant in that jurisdiction. This exception shall not apply to subsequent employment as a technical assistant in another jurisdiction.

2. An employee not having responsibility for code enforcement under the Virginia Statewide Fire Prevention Code shall be exempt from certification. Code enforcement shall mean, at a minimum, those actions outlined in §§ F-106.7 and F-106.9 of the Virginia Statewide Fire Prevention Code.

F-102.4. Maintenance inspections. The fire official may inspect all buildings, structures and premises to assure compliance with this code or any other ordinance affecting fire safety.

Exceptions: 1. Single family dwellings.
2. Dwelling units in multi-family dwellings.

F-102.5. Right of entry. The fire official may enter any structure or premises when there is reasonable cause to believe that an unsafe condition exists. Proper credentials shall be presented before entering occupied structures or premises. Legal assistance may be requested if entry is refused.

F-102.6. Coordinated inspections. The fire official shall coordinate inspections and administrative orders with any other state and local agencies having related inspection authority, and shall coordinate with the local building department on those inspections required by the USBC, Volume I, for new construction, when involving provisions of the BOCA National Fire Prevention Code, so that the owners and occupants will not be subjected to numerous inspections or conflicting orders. Whenever the fire official or an authorized representative observes an apparent or actual violation of the provisions of another law, ordinance or code, not within the inspector's authority to enforce, the inspector shall report the findings to the official having jurisdiction in order that such official may institute the necessary measures.

Note: Section 110.8 of the USBC, Volume I, requires the building official to coordinate those inspections with the local fire official.

F-102.7. Records. The local fire official shall keep records of fires, inspections, notices, orders issued, and other matters as directed by the local government. Fire records shall include information as to the cause, origin and the extent of damage. Records may be disposed of in accordance with the provisions of the Virginia Public Records Act (§ 42.1-76 et seq.) of the Code of Virginia, (a) after twenty years in the case of arson fires, (b) after five years in nonarson fires, and (c) after three years in the case of all other reports, notices, and orders issued.

F-102.8. Relief from personal responsibility. The local enforcing agency personnel shall not be personally liable for any damages sustained by any person in excess of the policy limits of errors

and omissions insurance, or other equivalent insurance obtained by the locality to insure against any action that may occur to persons or property as a result of any act required or permitted in the discharge of official duties while assigned to the department as an employee. The fire official or his subordinates shall not be personally liable for costs in any action, suit or proceedings that may be instituted in pursuance of the provisions of the SFPC as a result of any act required or permitted in the discharge of official duties while assigned to the enforcing agency as an employee, whether or not said costs are covered by insurance. Any suit instituted against any officer or employee because of an act performed in the discharge of the SFPC may be defended by the enforcing agency's legal representative. The State Fire Marshal or his subordinates shall not be personally liable for damages or costs sustained by any person when the State Fire Marshal or his subordinates are enforcing this code as part of their official duties under Section F-102.1.

F-102.9. Local regulations. Local governments may adopt fire prevention regulations that are more restrictive or more extensive in scope than the SFPC provided such regulations are not more restrictive than the USBC and do not affect the manner of construction, or materials to be used in the erection, alteration, repair, or use of a building or structure.

F-102.10. Procedures or requirements. The local governing body may establish such procedures or requirements as may be necessary for the enforcement of the SFPC.

F-102.11. Control of conflict of interest. The minimum standards of conduct for officials and employees of the enforcing agency shall be in accordance with the provisions of the State and Local Government Conflict of Interest Act, Chapter 40.1 (§ 2.1-639.1 et seq.) of Title 2.1 of the Code of Virginia.

SECTION F-103.0. DUTIES AND POWERS OF THE FIRE OFFICIAL.

F-103.1. General. The fire official shall enforce the provisions of the SFPC as provided herein and as interpreted by the State Building Code Technical Review Board in accordance with § 36-118 of the Code of Virginia.

F-103.2. Notices and orders. The fire official shall issue all necessary notices or orders to ensure compliance with the SFPC.

F-103.3. Delegation of duties and powers. The fire official may delegate duties and powers subject to any limitations imposed by the local government, but shall be responsible that any powers and duties delegated are carried out in accordance with this code.

SECTION F-104.0. PERMITS.

F-104.1. General. The fire official may require notification prior to activities involving the handling, storage or use of substances, materials or devices regulated by the SFPC; or to conducting processes which produce conditions hazardous to life or property; or to establishing a place of assembly.

F-104.1.1. State permits. The State Fire Marshal will not issue permits under the SFPC except that annual permits shall be issued under Chapter 30, Explosives, Ammunition and Blasting Agents.

F-104.1.2. Local permits. In those jurisdictions that enforce the SFPC, the Fire Official shall issue permits as required by Chapter 30, Explosives, Ammunition and Blasting Agents.

F-104.2. Permits required. The local fire official may require permits to be obtained as specified in the model code. Permits shall be made available to the fire official upon request.

F-104.3. Application for permit. Application for a permit shall be made on forms prescribed by the local fire official.

F-104.4. Issuance of permits. Before a permit is

issued, the local fire official shall make such inspections or tests as are necessary to assure that the use and activities for which application is made comply with the provisions of this code.

F-104.5. Conditions of permit. A permit shall constitute permission to store or handle materials, or to conduct processes in accordance with the SFPC and shall not be construed as authority to omit or amend any of the provisions of this code. Permits shall remain in effect until revoked, or for such period of time specified on the permit. Permits are not transferable.

F-104.6. Approved plans. Plans approved by the fire official are approved with the intent that they comply in all respects to this code. Any omissions or errors on the plans do not relieve the applicant of complying with all applicable requirements of this code.

F-104.7. Revocation of permit. The local fire official may revoke a permit or approval issued under the SFPC if conditions of the permit have been violated, or if the approved application, data or plans contain misrepresentation as to material fact.

F-104.8. Suspension of permit. A permit shall become invalid if the authorized activity is not commenced within six months after issuance of the permit, or if the authorized activity is suspended or abandoned for a period of six months after the time of commencement.

F-104.9. Fees. Fees may be levied by the enforcing agency in order to defray the cost of enforcement and appeals. The fees listed in Table F-104.9 shall be levied on those permits issued in accordance with F-104.1.1.

Table F-104.9.

**FEE SCHEDULE FOR EXPLOSIVES PERMITS
ISSUED BY THE STATE FIRE MARSHAL.**

TYPE OF PERMIT	FEE
To possess, store or dispose of explosives or blasting agents	\$50.00 per year
To use explosives or blasting agents	\$75.00 per year

SECTION F-105.0. APPEALS.

F-105.1. General. Appeals concerning the application of the Statewide Fire Prevention Code (SFPC) by the local enforcing agency shall first lie to a local Board of Fire Prevention Code Appeals (BFPCA) established in accordance with this section. Appeals from the application of the SFPC by the State Fire Marshal shall be made directly to the State Building Code Technical Review Board (TRB). Local governments without a BFPCA shall enter into an agreement with the governing body of another county or municipality or with some other agency, or a state agency, approved by the Department of Housing and Community Development to act on appeals.

F-105.2. Membership of BFPCA. The BFPCA shall consist of at least five members appointed by the local government and having terms of office established by written policy. Alternate members may be appointed to serve in the absence of any regular members, as such, shall have the full power and authority of the regular members. Regular and alternate members may be reappointed. Written records of current membership, including a record of the current chairman and secretary, shall be maintained by the enforcing agency. In order to provide continuity, the terms of the members may be of different length so that less than half will expire in any one year period.

F-105.2.1. Chairman. The BFPCA shall annually select one of its regular members to serve as chairman. In the event of the absence of the chairman at a hearing, the members present shall select an acting chairman.

F-105.2.2. Secretary. The local government shall appoint a secretary to the BFPCA to maintain a detailed record of all proceedings.

F-105.3. Qualifications of BFPCA members. BFPCA members shall be selected on the basis of their ability to render fair and competent decisions regarding application of the SFPC and shall to the extent possible, represent different

occupational or professional fields relating to building construction or fire prevention. Employees or officials of the local government shall not serve as members of the BFPCA.

F-105.4. Disqualification of member. A member of the BFPCA shall not hear an appeal in which that member has any personal, professional, financial or any other conflict of interest.

F-105.5. Application for appeal. An owner or occupant of a building, structure or property may appeal a decision of a local enforcing agency concerning the application of the SFPC to that building, structure or property by submitting a written request for appeal to the enforcing agency within 14 calendar days from the receipt of the decision to be appealed. A copy of the written decision of the enforcing agency upon which the appeal is being made shall be submitted by the applicant and retained as part of the record by the secretary of the BFPCA. In the case of an appeal of the decision of the State Fire Marshal, the applicant shall submit an application for appeal to the Office of the TRB within 14 calendar days from the receipt of the decision to be appealed. A copy of the written decision of the State Fire Marshal upon which the appeal is being made shall also be submitted. The application for appeal shall be stamped or otherwise marked by the enforcing agency or the Office of the TRB to indicate the date received. Failure to submit an application for appeal within the time limit established by this action shall constitute an acceptance of the enforcing agency or State Fire Marshal's decision.

F-105.6. BFPCA meeting. The BFPCA shall meet within 30 calendar days after the date of receipt of the application for appeal. Notice indicating the time and place of the hearing shall be sent to the parties in writing at least 14 calendar days prior to the date of the hearing. Less notice may be given if agreed upon by the applicant.

F-105.7. Hearing procedures. All hearings

before the BFPCA shall be open to the public. The applicant, the enforcing agency's representative and any person whose interests are affected shall be given an opportunity to be heard. The chairman shall have the power and duty to direct the hearing, rule upon the acceptance of evidence and oversee the record of all proceedings. Hearings from a decision of the State Fire Marshal to the TRB are governed by Article 2 (§ 36-108 et seq.) of Chapter 6 of Title 36 of the Code of Virginia.

F-105.7.1. Postponement. When five members of the BFPCA are not present to hear an appeal, the applicant shall have the right to request a postponement of the hearing. The enforcing agency shall reschedule the appeal within 30 calendar days of the postponement.

F-105.8. Decision of BFPCA. The BFPCA shall have the power to reverse or modify the decision of the enforcing agency by a concurring vote of a majority of those present.

F-105.8.1. Resolution. The decision of the BFPCA shall be by resolution signed by the chairman and retained as part of the record by the enforcing agency. The following wording shall be part of the resolution:

"Upon receipt of this decision, any person who was a party to the appeal may appeal to the State Building Code Technical Review Board by submitting an application to the State Building Code Technical Review Board within 21 calendar days. Application forms are available from the Office of the State Building Code Technical Review Board, 501 North Second Street, Richmond, Virginia 23219, (804) 371-7170."

F-105.9. Further appeal. After final determination by the BFPCA, any person who is a party to the local appeal may appeal to the TRB by submitting an application to the Office of the TRB within 21 calendar days of receipt of the decision of the BFPCA. Failure to submit an application for appeal within the time limit established by this section shall constitute acceptance of the enforcing agency's decision.

F-105.9.1. Information to be submitted. Copies of the decision of the enforcing agency and the resolution of the BFPCA which is being appealed shall be submitted with the application for appeal. Upon request by the Office of the TRB, the enforcing agency shall submit a copy of all pertinent information from the record of the BFPCA.

F-105.10. Decision of TRB. Procedures of the TRB for both appeals from a decision of the State Fire Marshal and from the BFPCA are in accordance with Article 2 (§ 36-108 et seq.) of Chapter 6 of Title 36 of the Code of Virginia. Decisions of the TRB shall be final if no appeal is made therefrom and the enforcing agency or State Fire Marshal shall take action accordingly.

SECTION F-106.0 UNSAFE CONDITIONS.

F-106.1. General. The fire official shall order the following dangerous or hazardous conditions or materials to be removed or remedied in accordance with the SFPC:

1. Dangerous conditions which are liable to cause or contribute to the spread of fire in or on said premises, building or structure or endanger the occupants thereof.

2. Conditions which would interfere with the efficiency and use of any fire protection equipment.

3. Obstructions to or on fire escapes, stairs, passageways, doors or windows, liable to interfere with the egress of occupants or the operation of the fire department in case of fire.

4. Accumulations of dust or waste material in air conditioning or ventilating systems or grease in kitchen or other exhaust ducts.

5. Accumulations of grease on kitchen cooking equipment, or oil, grease or dirt upon, under or around any mechanical equipment.

6. Accumulations of rubbish, waste, paper, boxes, shavings, or other combustible materials, or excessive storage of any combustible material.

7. Hazardous conditions arising from defective or improperly used or installed electrical wiring, equipment or appliances.

8. Hazardous conditions arising from

defective or improperly used or installed equipment for handling or using combustible, explosive or otherwise hazardous materials.

9. Dangerous or unlawful amounts of combustible, explosive or otherwise hazardous materials.

10. All equipment, materials, processes or operations which are in violation of the provisions and intent of this code.

F-106.2. Maintenance. The owner shall be responsible for the safe and proper maintenance of any building, structure, premises or lot. In all new and existing buildings and structures, the fire protection equipment, means of egress, alarms, devices and safeguards required by the USBC shall be maintained in a safe and proper operating condition.

Note: Also see Sections F-504.4 and F-504.4.1 of this code for further information.

F-106.3. Occupant responsibility. If an occupant of a building creates conditions in violation of this code, by virtue of storage, handling and use of substances, materials, devices and appliances, the occupant shall be held responsible for the abatement of said hazardous conditions.

F-106.4. Unsafe buildings. All buildings and structures that are or shall hereafter become unsafe or deficient in adequate exit facilities or which constitute a fire hazard, or are otherwise dangerous to human life or the public welfare, or by reason of illegal or improper use, occupancy or maintenance or which have sustained structural damage by reason of fire, explosion, or natural disaster shall be deemed unsafe buildings or structures. A vacant building, or portion of a building, unguarded or open at door or window shall be deemed a fire hazard and unsafe within the meaning of this code. Unsafe buildings shall be reported to the building or maintenance code official who shall take appropriate action under the provisions of the USBC, Volume I - New Construction Code or Volume II - Building Maintenance Code, to secure abatement by repair and rehabilitation or by demolition.

F-106.5. Evacuation. When, in the opinion of the fire official, there is actual and potential danger to the occupants or those in the proximity of any building, structure or premises because of unsafe structural conditions, or inadequacy of any means of egress, the presence of explosives, explosive fumes or vapors, or the presence of toxic fumes, gases or materials, the fire official may order the immediate evacuation of the building, structure or premises. All notified occupants shall immediately leave the building, structure or premises and no person shall enter until authorized to do so by the fire official.

F-106.6. Unlawful continuance. It is deemed a violation of the SFPC for any person to refuse to leave, interfere with the evacuation of the other occupants or continue any operation after having been given an evacuation order except such work as that person is directed to perform to remove a violation or unsafe condition.

F-106.7. Notice of violation. Whenever the fire official observes a violation of this code or ordinance under the fire official's jurisdiction, the fire official shall prepare a written notice of violation describing the condition deemed unsafe, citing the applicable code section and specifying time limits for the required repairs or improvements to be made to render the building, structure or premises safe and secure. The written notice of violation of this code shall be served upon the owner, a duly authorized agent or upon the occupant or other person responsible for the conditions under violation. Such notice of violation shall be served either by delivering a copy of same to such persons by mail to the last known post office address, delivered in person or by delivering it to and leaving it in the possession of any person in charge of the premises, or in the case such person is not found upon the premises, by affixing a copy thereof, in a conspicuous place at the entrance door or avenue of access; and such procedure shall be deemed the equivalent of personal notice.

F-106.8. Failure to correct violations. If the notice of violation is not complied with in the time specified by the fire official, the fire official shall request the legal counsel of the jurisdiction to institute the appropriate legal proceedings to restrain, correct or abate any notice of violation which is not complied with in the specified time or require removal or termination of the unlawful use of the building or structure. The local law enforcement agency of the jurisdiction shall be requested by the fire official to make arrests for any offense against this code or orders of the fire official affecting the immediate safety of the public when the fire official is not certified in accordance with § 27-34.2 of the Code of Virginia.

F-106.9. Issuing summons for violation. If certified in accordance with § 27-34.2 of the Code of Virginia, the fire official may issue a summons in lieu of the notice of violation.

F-106.10. Penalty for violation. Violations are a Class 1 misdemeanor in accordance with § 27-100 of the Code of Virginia. Each day that a violation continues, after a service of notice as provided for in this code, shall be deemed a separate offense.

F-106.11. Abatement of violation. Conviction of a violation of the SFPC shall not preclude the institution of appropriate legal action to require correction or abatement of the violation or to prevent other violations or recurring violations of the SFPC relating to use of the building or premises.

**AMENDMENTS TO THE BOCA NATIONAL FIRE
PREVENTION CODE/1993 EDITION**

As provided in Section F-101.3 of the SFPC, the amendments noted in this Addendum shall be made to the BOCA National Fire Prevention Code/1993 edition for use as part of the SFPC.

CHAPTER 1. ADMINISTRATION.

Chapter 1, Administration is deleted in its entirety and replaced with Chapter 1 of the SFPC.

CHAPTER 2. DEFINITIONS.

A. Change Section F-201.3 to read:
F-201.3. Terms defined in the other codes. Where terms are not defined in this code and are defined in the USBC, they shall have the meanings defined by the USBC.

B. Change the following definitions in Section F-202.0, General Definitions, to read:

"**Blasting agent**" means any explosive material that has been tested and approved in accordance with the provisions of DOT 49 CFR which includes that the finished product, as mixed for use and shipment, cannot be detonated by a No. 8 test blasting cap when unconfined.

"**Building code official**" means the designated authority charged with the administration and enforcement of the USBC, Volume I - New Construction Code.

"**Code Official**" means the designated authority charged with the administration and enforcement of the USBC, Volume II - Building Maintenance Code.

Note: when "code official" appears in the BOCA National Fire Prevention Code, it shall mean "fire official".

"**Explosive**" means any chemical compound, mixture or device, the primary or common purpose of which is to function by explosion. The term "explosive" includes all materials classified as Class A, Class B, or Class C explosives by DOT regulations and includes, but is not limited to, dynamite, black powder, pellet

powders, smokeless powder, initiating explosives, blasting caps, electric blasting caps, safety fuse, fuse igniters, fuse lighters, squibs, cordeau detonate fuse, instantaneous fuse, igniter cord and igniters.

"**Fireworks**" means any item known as firecracker, torpedo, skyrocket, or other substance or thing, of whatever form or construction, that contains any explosive or inflammable compound or substance, and is intended, or commonly known, as fireworks and which explodes, rises into the air or travels laterally, or fires projectiles into the air. The term "fireworks" does not include auto flares, caps for pistols, pinwheels, sparklers, fountains or Pharaoh's Serpents provided, however, these permissible items may only be used, ignited or exploded on private property with the consent of the owner of such property.

"**Structure**" means an assembly of materials forming a construction for use including stadiums, gospel and circus tents, reviewing stands, platforms, stagings, observation towers, radio towers, water tanks, trestles, piers, wharves, swimming pools, amusement devices, storage bins, and other structures of this general nature. The word structure shall be construed as though followed by the words "or part or parts thereof" unless the context clearly requires a different meaning.

C. Add these new definitions to Section F-202.0, General Definitions:

"**Agricultural blasting**" means any blasting operation which is conducted on no less than five acres of real estate devoted to agricultural or horticultural use as defined in § 58.1-3230 of the Code of Virginia.

"**Artificial Barricade**" means an artificial mound or revetted wall of earth of a minimum thickness of three feet.

"**Barricaded**" means the effective screening of a building containing explosive materials from the magazine or other building, railway, or highway by a natural or an artificial barrier. A

ADDENDUM

straight line from the top of any sidewall of the building containing explosive materials to the eave line of any magazine or other building or to a point twelve feet above the center of a railway or highway shall pass through such barrier.

"**Blaster**" or "**shot firer**" means that qualified person in charge of, and responsible for, the loading and firing of an explosive or blasting agent.

"**Building Code**" means the building code in effect at the time of construction.

"**Detonator**" means any device containing any initiating or primary explosive that is used for initiating detonation. A detonator may not contain more than 10 grams of total explosives by weight, excluding ignition or delay charges. The term includes, but is not limited to, electric blasting caps of instantaneous and delay types, blasting caps for use with safety fuses, detonating cord delay connectors, and nonelectric instantaneous and delay blasting caps which use detonating cord, shock tube, or any other replacement for electric leg wires. All types of detonators in strengths through No. 8 cap should be rated at 1 1/2 lbs. of explosives per 1,000 caps. For strengths higher than No. 8 cap, consult the manufacturer.

"**Explosive materials**" means explosives, blasting agents and detonators.

"**Fire official**" means the designated authority charged with the administration and enforcement of the SFPC.

"**Highway**" means any public street, public alley, or public road. "Public Highways Class A to D" are highways with average traffic volume of 3,000 or less vehicles per day as specified in "American Civil Engineering Practice" (Abbett, Vol. 1, Table 46, Sec 3-74, 1956 Edition, John Wiley and Sons).

"**Inhabited Building**" means a building regularly occupied in whole or part as a habitation for human beings, or any church, schoolhouse, railroad station, store, or other structure where people are accustomed to assemble, except any building or structure occupied in connection with the manufacture, transportation, storage or use of explosive materials.

"**Magazine**" means any building, structure, or container, other than an explosives manufacturing building, approved for the storage of explosive materials.

"**Natural Barricade**" means natural features of the ground, such as hills, or timber of sufficient density that the surrounding exposures which require protection cannot be seen from the magazine when the trees are bare of leaves.

"**Peak particle velocity**" means the maximum component of the three mutually perpendicular components of motion at a given point.

"**Propellant-actuated power device**" means any tool or special mechanized device or gas generator system which is actuated by a propellant or which releases and directs work through a propellant charge. (See special industrial explosive device.)

"**Railway**" means any steam, electric, or other railroad or railway which carries passengers for hire.

"**Semitrailer**" means every vehicle of the trailer type so designed and used in conjunction with a motor vehicle that some part of its own weight (and that of its own load) rests upon or is carried by another vehicle.

"**Tractor truck**" means every motor vehicle designed and used primarily for drawing other vehicles and not so constructed as to carry a load other than a part of the load and weight of the vehicle attached thereto.

"**Transport**" or "**transportation**" means any movement of property by any mode, and any packing, loading, unloading, identification, marking, placarding, or storage incidental thereto.

D. Delete the following definitions from Section F-202.0, General Definitions:
Liquefied petroleum gas (LP-gas or LPG)
Liquefied petroleum gas equipment

CHAPTER 4. OPEN FLAMES OR BURNING.

Change Section F-403.1 to read:

F-403.1. General. Open burning shall be allowed in accordance with the laws and regulations set forth by the State Air Pollution

Control Board, the Department of Forestry, and as regulated by the locality.

**CHAPTER 5.
FIRE PROTECTION SYSTEMS.**

Add new Section F-519.0, Smoke Detectors for the Deaf and Hearing-impaired, to read:

SECTION F-519.0. SMOKE DETECTORS FOR THE DEAF AND HEARING-IMPAIRED.

F-519.1. Audible and visual alarms. Audible and visual alarms, meeting the requirements of UL Standard 1638, and installed in accordance with NFiPA/ANSI 72G, shall be provided in occupancies housing the hard of hearing, as required by § 36-99.5 of the Code of Virginia; however, all visual alarms shall provide a minimum intensity of 100 candela. Portable alarms meeting these requirements shall be acceptable.

CHAPTER 7. EMERGENCY PLANNING AND PREPAREDNESS.

Add new Section F-707.4, Fire Exit Drills, to read:

F-707.4. Fire exit drills. Fire exit drills shall be conducted annually by building staff personnel or the owner of the building in accordance with the fire safety plan and shall not affect other current occupants.

**CHAPTER 18.
OIL AND GAS PRODUCTION.**

Delete Chapter 18, Oil and Gas Production, as it is covered by the Virginia Gas and Oil Act, Chapter 22.1 (§ 45.1-361.1 et seq.) of Title 45.1 of the Code of Virginia.

CHAPTER 30. EXPLOSIVES, AMMUNITION AND BLASTING AGENTS.

Chapter 30, Explosives, Ammunition and Blasting Agents, is deleted in its entirety and replaced with Chapter 30 of the SFPC, as

follows:

SECTION F-3001.0. GENERAL.

F-3001.1. Scope. The equipment, processes and operations involving the manufacture, possession, storage, sale, transportation and use of explosives and blasting agents shall comply with the applicable requirements of this code and the provisions of this article and shall be maintained in accordance with NFiPA 495, NFiPA 498, and DOT 49CFR listed in Appendix A except as herein specifically exempted or where provisions of this article do not specifically cover conditions and operations, and with the Institute of Makers of Explosives (IME) Safety Library Publications, with Regulations Governing the Transportation of Hazardous Materials as promulgated by the Virginia Waste Management Board and with the Virginia Motor Carrier regulations.

F-3001.2. Exceptions. Nothing in this article shall be construed as applying to the following explosive uses:

1. The Armed Forces of the United States or of a state.
2. Explosives in forms prescribed by the official United States Pharmacopoeia.
3. The sale or use of fireworks which are regulated by Chapter 31
4. Laboratories engaged in testing explosive materials.
5. The possession, storage and use of not more than 5 pounds (2.27 kg) of smokeless powder, black powder, and 1000 small arms primers for hand loading of small arms ammunition for personal use.
6. The manufacture, possession, storage and use of not more than 5 pounds (2.27 kg) of explosives or blasting agents in educational, governmental or industrial laboratories for instructional or research purposes when under the direct supervision of experienced, competent persons.
7. The transportation and use of explosives or blasting agents by any federal agency, the Virginia Department of State Police, or fire and law enforcement officials acting in their official capacity in the discharge of their duties; nor to

ADDENDUM

the storage, handling, or use of explosives or blasting agents pursuant to the provisions of Title 45.1 of the Code of Virginia (Department of Mines, Minerals and Energy).

F-3001.3. Permit required. A permit shall be obtained from the code official for any of the following conditions or operations:

1. To possess, store, or otherwise dispose of explosives or blasting agents.
2. To use explosives or blasting agents:
 - a. A permit shall be issued for each project.
 - b. The permit shall specify the type of blasting and any special conditions. To the extent that blasting will occur within any waters of the Commonwealth or in any of the waters under its jurisdiction, evidence of a valid Marine Resources Commission permit, or "no permit necessary" authorization, will be required.
3. To operate a terminal for handling explosives or blasting agents.
4. To manufacture explosives or blasting agents, providing the following conditions are met:
 - a. Registration with the Department of Housing and Community Development;
 - b. Valid license from the Bureau of Alcohol, Tobacco and Firearms; and
 - c. Valid license to do business in the Commonwealth of Virginia.
5. To sell explosives and blasting agents, providing the following conditions are met:
 - a. Registration with the Department of Housing and Community Development;
 - b. Valid license from the Bureau of Alcohol, Tobacco and Firearms; and
 - c. Valid license to do business in the Commonwealth of Virginia.

Exception: Annual permits for the use of explosives shall be issued to any state regulated public utility.

F-3001.3.1. Prohibited permits. Permits as required above shall not be issued for:

1. Liquid nitroglycerin and nitrate esters.
2. Dynamite (except gelatin dynamite) containing over 60% of liquid explosive

ingredient.

3. Leaking, damaged, or defective packages or containers of high explosives.

4. Nitrocellulose in a dry and uncompressed condition to be shipped or transported.

5. Fulminate of mercury in a dry condition and fulminate of all other metals in any condition.

Exception: Fulminate of metals which is a component of manufactured articles not otherwise forbidden.

6. Explosive compositions that ignite spontaneously or undergo marked decomposition, rendering the products or their use more hazardous, when subjected for 48 consecutive hours or less to a temperature of 167°F (75°C).

7. New explosives until approved by DOT 49CFR listed in Appendix A, except for permits issued to educational, governmental or industrial laboratories for instructional or research purposes.

8. Explosives forbidden by DOT 49CFR listed in Appendix A.

9. Explosives not packed or marked in accordance with the requirements of DOT 49CFR listed in Appendix A.

10. Explosives containing an ammonium salt and a chlorate.

F-3001.4. Certification required. The use of explosive materials shall be conducted or supervised on-site by blasters certified in accordance with the Virginia Certification Standards (VR 394-01-2). The blaster shall carry proof of certification during the loading or firing of explosive materials.

Exception: Individuals conducting agricultural blasting operations on their own property.

F-3001.4.1. Certification fee. The Department of Housing and Community Development shall charge a \$20.00 fee to applicants for restricted blaster certification or unrestricted blaster certification.

F-3001.5. Liability insurance. The company or individual applying for a permit to blast,

manufacture, or sell explosives shall provide proof of insurance in an amount determined by the fire official but in no case less than \$500,000.

Exception: Liability insurance shall not be required with an agricultural blasting permit when the blast is conducted on the applicant's personal property.

**SECTION F-3002.0.
GENERAL REQUIREMENTS.**

F-3002.1. Storage. The storage of explosives and blasting agents is prohibited within the legal geographic boundaries of any district where such storage is prohibited by the authority having jurisdiction.

Exception: Temporary storage for use in connection with approved blasting operations, provided, however, this prohibition shall not apply to wholesale and retail stocks of small arms ammunition, explosive bolts, explosive rivets or cartridges for explosive actuated power tools in quantities involving less than 500 pounds (227 kg) of explosive material.

F-3002.2. Sale and display. Explosives shall not be sold, given, delivered, or transferred to any person or company not in possession of a valid permit. A person shall not sell or display explosives or blasting agents on highways, sidewalks, public property or in places of public assembly or education.

**SECTION F-3003.0.
STORAGE OF EXPLOSIVE MATERIALS.**

F-3003.1. General. Explosives, including special industrial high explosive materials, shall be stored in magazines which meet the requirements of this article. This shall not be construed as applying to wholesale and retail stocks of small arms ammunition, explosive bolts, explosive rivets or cartridges for explosive-actuated power tools in quantities involving less than 500 pounds (227 kg) of explosive material. Magazines shall be in the custody of a competent person at all times who shall be at least 21 years of age, and who shall be held responsible for compliance

with all safety precautions.

F-3003.2. Control in wholesale and retail stores. Explosive materials shall not be stored within wholesale or retail stores. The storage of explosives for wholesale and retail sales shall be in approved outdoor magazines except that not more than 50 pounds of black or smokeless powder may be stored in a Type 4 indoor magazine.

F-3003.3. Magazine clearances. Magazines shall be located away from inhabited buildings, passenger railways, public highways and other magazines in conformance with Table F-3003, except as provided in Section F-3003.2.

F-3003.4. Magazine construction. Magazines shall be constructed and maintained in accordance with IME publication #1.

F-3004.4.1. Magazine heat and light. Magazines shall not be provided with artificial heat or light, except that if artificial light is necessary, an approved electric safety flashlight or safety lantern shall be used.

F-3003.5. Safety precautions. Smoking, matches, open flames, spark producing devices and firearms shall be prohibited inside or within 50 feet (15.24m) of magazines. Combustible materials shall not be stored within 50 feet (15.24m) of magazines.

F-3003.5.1. Surrounding terrain. The land surrounding magazines shall be kept clear of brush, dried grass, leaves, trash and debris for a distance of at least 25 feet (7.62 m).

F-3003.5.2. Locking security. Magazines shall be kept locked except when being inspected or when explosives are being placed therein or being removed therefrom.

F-3003.5.3. Magazine housekeeping. Magazines shall be kept clean, dry and free of grit, paper, empty packages or rubbish.

ADDENDUM

F-3003.5.4. Separation of detonators and explosives. Blasting caps, electric blasting caps, detonating primers and primed cartridges shall

not be stored in the same magazine with other explosives.

Table F-3003 (3)
TABLE OF DISTANCES FOR STORAGE OF EXPLOSIVES (2)

QUANTITY OF EXPLOSIVE MATERIALS		DISTANCES IN FEET							
		Inhabited Buildings		Public Highways Class A to D		Passenger Railways-Public Highways with Traffic Volume of more than 3,000 Vehcls/Day		Separation of Magazines(1)	
Pounds Over	Pounds Not Over	Barri-caded	Unbarr-icaded	Barri-caded	Unbarr-icaded	Barri-caded	Unbarr-icaded	Barri-caded	Unbarr-icaded
0	5	70	140	30	60	51	102	6	12
5	10	90	180	35	70	64	128	8	16
10	20	110	220	45	90	81	162	10	20
20	30	125	250	50	100	93	186	11	22
30	40	140	280	55	110	103	206	12	24
40	50	150	300	60	120	110	220	14	28
50	75	170	340	70	140	127	254	15	30
75	100	190	380	75	150	139	278	16	32
100	125	200	400	80	160	150	300	18	36
125	150	215	430	85	170	159	318	19	38
150	200	235	470	95	190	175	350	21	42
200	250	255	510	105	210	189	378	23	46
250	300	270	540	110	220	201	402	24	48
300	400	295	590	120	240	221	442	27	54
400	500	320	640	130	260	238	476	29	58
500	600	340	680	135	270	253	506	31	62
600	700	355	710	145	290	266	532	32	64
700	800	375	750	150	300	278	556	33	66
800	900	390	780	155	310	289	578	35	70
900	1,000	400	800	160	320	300	600	36	72
1,000	1,200	425	850	165	330	318	636	39	78
1,200	1,400	450	900	170	340	336	672	41	82
1,400	1,600	470	940	175	350	351	702	43	86
1,600	1,800	490	980	180	360	366	732	44	90
1,800	2,000	505	1,010	185	370	378	756	45	90
2,000	2,500	545	1,090	190	380	408	816	49	98
2,500	3,000	580	1,160	195	390	432	864	52	104
3,000	4,000	635	1,270	210	420	474	948	58	116
4,000	5,000	685	1,370	225	450	513	1,026	61	122
5,000	6,000	730	1,460	235	470	546	1,092	65	130
6,000	7,000	770	1,540	245	490	573	1,146	68	136
7,000	8,000	800	1,600	250	500	600	1,200	72	144
8,000	9,000	835	1,670	255	510	624	1,248	75	150
9,000	10,000	865	1,730	260	520	645	1,290	78	156
10,000	12,000	875	1,750	270	540	687	1,374	82	164
12,000	14,000	885	1,770	275	550	723	1,446	87	174
14,000	16,000	900	1,800	280	560	756	1,512	90	180
16,000	18,000	940	1,800	285	570	786	1,572	94	188
18,000	20,000	975	1,950	290	580	813	1,626	98	196
20,000	25,000	1,055	2,000	315	630	876	1,752	105	210
25,000	30,000	1,130	2,000	340	680	933	1,866	112	224
30,000	35,000	1,205	2,000	360	720	981	1,962	119	238
35,000	40,000	1,275	2,000	380	760	1,026	2,000	124	248
40,000	45,000	1,340	2,000	400	800	1,068	2,000	129	258
45,000	50,000	1,400	2,000	420	840	1,104	2,000	135	270
50,000	55,000	1,460	2,000	440	880	1,140	2,000	140	280
55,000	60,000	1,515	2,000	455	910	1,173	2,000	145	290
60,000	65,000	1,565	2,000	470	940	1,206	2,000	150	300

65,000	70,000	1,610	2,000	485	970	1,236	2,000	155	310
70,000	75,000	1,655	2,000	500	1,000	1,263	2,000	160	320
75,000	80,000	1,695	2,000	510	1,020	1,293	2,000	165	330
80,000	85,000	1,730	2,000	520	1,040	1,317	2,000	170	340
85,000	90,000	1,760	2,000	530	1,060	1,344	2,000	175	350
90,000	95,000	1,790	2,000	540	1,080	1,368	2,000	180	360
95,000	100,000	1,815	2,000	545	1,090	1,392	2,000	185	370
100,000	110,000	1,835	2,000	550	1,100	1,437	2,000	195	390
110,000	120,000	1,855	2,000	555	1,110	1,479	2,000	205	410
120,000	130,000	1,875	2,000	560	1,120	1,521	2,000	215	430
130,000	140,000	1,890	2,000	565	1,130	1,557	2,000	225	450
140,000	150,000	1,900	2,000	570	1,140	1,593	2,000	235	470
150,000	160,000	1,935	2,000	580	1,160	1,629	2,000	245	490
160,000	170,000	1,965	2,000	590	1,180	1,662	2,000	255	510
170,000	180,000	1,990	2,000	600	1,200	1,695	2,000	265	530
180,000	190,000	2,010	2,000	605	1,210	1,725	2,000	275	550
190,000	200,000	2,030	2,000	610	1,220	1,755	2,000	285	570
200,000	210,000	2,055	2,000	620	1,240	1,782	2,000	295	590
210,000	230,000	2,100	2,100	635	1,270	1,836	2,000	315	630
230,000	250,000	2,155	2,155	650	1,300	1,890	2,000	335	670
250,000	275,000	2,215	2,215	670	1,340	1,950	2,000	360	720
275,000	300,000	2,275	2,275	690	1,380	2,000	2,000	385	770

Numbers in () refer to explanatory notes

NOTE 1 - When two or more storage magazines are located on the same property, each magazine must comply with the minimum distances specified from inhabited buildings, railways, and highways, and, in addition, they should be separated from each other by not less than the distances shown for "Separation of Magazines," except that the quantity of explosive materials contained in detonator magazines shall govern in regard to the spacing of said detonator magazines from magazines containing other explosive materials. If any two or more magazines are separated from each other by less than the specified "Separation of Magazines" distances, then such two or more magazines, as a group, must be considered as one magazine, and the total quantity of explosive materials stored in such group must be treated as if stored in a single magazine located on the site of any magazine of the group, and must comply with the minimum of distances specified from other magazines, inhabited buildings, railways, and highways.

NOTE 2 - Storage in excess of 300,000 lbs. of explosive materials, in one magazine is generally not required for commercial enterprises.

NOTE 3 - This Table applies only to the manufacture and permanent storage of commercial explosive materials. It is not applicable to transportation of explosives or any handling or temporary storage necessary or incident thereto. It is not intended to apply to bombs, projectiles, or other heavily encased explosives.

F-3003.5.5. Explosive unpacking. Metal or wooden packages of explosives shall not be unpacked or repacked in a magazine nor within 50 feet (15.24m) of a magazine.

F-3003.5.6. Magazine contents. Magazines shall not be used for the storage of any metal tools or of any commodity except explosives, but this restriction shall not apply to the storage of blasting agents, blasting supplies and oxidizers used in compound blasting agents.

F-3003.6. Unstable explosives. When an explosive has deteriorated to an extent that it is in

an unstable or dangerous condition, or if liquid leaks from any explosive, then the person in possession of such explosive shall immediately report that fact to the code official and upon his approval shall proceed to destroy such explosives and clean floors stained with nitroglycerin or other such liquids in accordance with the instructions of the manufacturer. Only qualified, experienced persons shall do the work of destroying explosives.

Note: Disposal of explosives as a "waste" should be in accordance with the Department of Waste Management regulations.

ADDENDUM

F-3003.7. Magazine warnings. Property upon which Type 1 magazines and outdoor magazines of Types 2, 4 and 5 are located shall be posted with signs stating "Explosives - Keep Off". The signs shall be located such that the possibility of a bullet shot at the sign and hitting the magazine is minimized.

SECTION F-3004.0.

TRANSPORTATION OF EXPLOSIVES.

F-3004.1. General. The transportation of explosive materials shall comply with applicable provisions of the Regulations Governing the Transportation of Hazardous Materials as promulgated by the Virginia Waste Management Board.

F-3004.2. Enforcement. The Department of State Police, together with all law enforcement and peace officers of the Commonwealth who have satisfactorily completed the course in Hazardous Materials Compliance and Enforcement as prescribed by the U.S. Department of Transportation, Research and Special Programs, and Office of Hazardous Materials Transportations, in federal safety regulations and safety inspection procedures pertaining to the transportation of hazardous materials, shall enforce the provisions of this section. Those officers shall annually receive in-service training in current federal safety standards and safety inspection procedures pertaining to the transportation of hazardous materials.

SECTION F-3005.0. STORAGE OF BLASTING AGENTS AND SUPPLIES.

F-3005.1. General. Blasting agents or oxidizers, when stored in conjunction with explosives, shall be stored in the manner set forth in Section F-3003.0 for explosives. The quantity of blasting agents and one half the quantity of oxidizers shall be included when computing the total quantity of explosives for determining distance requirements.

F-3005.2. Storage location. Buildings used for

storage of blasting agents separate from explosives shall be located away from inhabited buildings, passenger railways and public highways in accordance with Table F-3003.

F-3005.3. Storage housekeeping. The interior of buildings used for the storage of blasting agents shall be kept clean and free from debris and empty containers. Spilled materials shall be cleaned up promptly and safely removed. Combustible materials, flammable liquids, corrosive acids, chlorates, nitrates other than ammonium nitrate or similar materials shall not be stored in any building containing blasting agents unless separated therefrom by construction having a fire-resistance rating of not less than 1 hour. The provisions of this section shall not prohibit the storage of blasting agents together with nonexplosive blasting supplies.

F-3005.4. Trailer storage requirements. Semitrailers or full trailers used for temporarily storing blasting agents shall be located away from inhabited buildings, passenger railways and public highways, in accordance with Table F-3003. Trailers shall be provided with substantial means for locking and trailer doors shall be kept locked except during the time of placement or removal of blasting agents.

F-3005.5. Oxidizers and fuels. Piles of oxidizers and buildings containing oxidizers shall be adequately separated from readily combustible fuels.

F-3005.6. Oxidizer handling. Caked oxidizer, either in bags or in bulk, shall not be loosened by blasting.

SECTION F-3006.0. HANDLING OF EXPLOSIVES.

F-3006.1. Mixing blasting agents. Buildings or other facilities used for mixing blasting agents shall be located away from inhabited buildings, passenger railways and public highways, in accordance with Table F-3003.

F-3006.2. Quantity of mixing agents. Not more than one day's production of blasting agents or the limit determined by Table F-3003, whichever is less, shall be permitted in or near the building or other facility used for mixed blasting agents. Larger quantities shall be stored in separate buildings or magazines.

F-3006.3. Compounding standards. Compounding and mixing of recognized formulations of blasting agents shall be conducted in accordance with NFPA 495 and DOT 49CFR listed in Chapter 44.

F-3006.4. Ignition protection. Smoking or open flames shall not be permitted within 50 feet (15.24m) of any building or facility used for the mixing of blasting agents.

F-3006.4.1. Unpacking tools. Tools used for opening packages of explosives shall be constructed of nonsparking materials.

Exception. Metal slitters may be used for opening paper and fiberboard containers.

F-3006.5. Waste disposal. Empty oxidizer bags shall be disposed of daily by burning in a safe manner (in an open area and at a safe distance from buildings or combustible materials).

F-3006.5.1. Packing material disposal. Empty boxes and paper and fiber packing materials which have previously contained high explosives shall not be used again for any purpose, but shall be destroyed by burning at an approved, isolated location out of doors, and any person shall not be closer than 100 feet (30.48 m) during the course of said burning.

F-3006.6. Control. Explosives shall not be abandoned.

SECTION F-3007.0. BLASTING.

F-3007.1. Time. Blasting operations shall be conducted during daylight hours except when otherwise approved.

F-3007.2. Personnel. The handling and firing of explosives shall be performed by the person certified as a blaster under Section F-3001.4 of this code or by employees under that person's direct on-site supervision who are at least 21 years old.

1. A person shall not handle explosives while under the influence of intoxicants or narcotics.

2. A person shall not smoke or carry matches while handling explosives or while in the vicinity thereof.

3. An open flame light shall not be used in the vicinity of explosives.

F-3007.3. Clearance at site. At the site of blasting operations, Class II magazines shall be located as far away as practicable from neighboring inhabited buildings, railways, highways, and other magazines.

F-3007.4. Notice. Whenever blasting is being conducted within 200 feet of gas, electric, water, fire, alarm, telephone, telegraph or steam utilities, the blaster shall notify the appropriate representatives of such utilities at least 24 hours in advance of blasting, specifying the location and intended time of such blasting. Verbal notice shall be confirmed with written notice. This time limit shall not be waived except in an emergency as determined by the code official.

F-3007.5. Responsibility. Before a blast is fired, the person in charge shall make certain that all surplus explosives are in a safe place, all persons and vehicles are at a safe distance or under sufficient cover, and a warning signal has been sounded.

F-3007.6. Precautions. Due precautions shall be taken to prevent accidental discharge of electric blasting caps from current induced by radio or radar transmitters, lightning, adjacent power lines, dust storms or other sources of extraneous electricity. These precautions shall include:

1. The suspension of all blasting operations and removal of persons from the blasting area during the approach and progress of an electrical storm;

ADDENDUM

2. The posting of signs warning against the use of mobile radio transmitters on all roads within 350 feet (106.75m) of the blasting operations; and

3. Compliance with NFPA 495 listed in Appendix A when blasting within 1-1/2 miles (2.41 km) of broadcast or highpower short wave radio transmitters.

4. Misfires shall be handled as directed by equipment manufacturers with no one entering the blasting site, except the blaster, until the loaded charges have been made to function or have been removed.

F-3007.7. Congested areas. As required by the fire official, when blasting is done in congested areas or in close proximity to a building, structure, railway, highway or any other installation susceptible to damage, the blast shall be covered before firing, with a mat or earth, or both, so that it is capable of preventing rock from being thrown into the air out of the blast area.

F-3007.8. Blast records. A record of each blast shall be kept and retained for at least three years and shall be available for inspection by the fire official. These records shall contain the following minimum data:

1. Name of contractor.
2. Location and time of blast.
3. Name of certified blaster in charge.
4. Type of material blasted.
5. Number of holes bored and spacing.
6. Diameter and depth of holes.
7. Type and amount of explosives.
- * 8. Amount of explosives per delay of 8 milliseconds or greater.
9. Method of firing and type of circuit.
10. Direction and distance in feet to nearest dwelling, public building, school, church, commercial or institutional building.
11. Weather conditions.
12. Whether or not mats or other precautions were used.
- * 13. Type of detonators and delay periods.
14. Type and height of stemming.
15. Seismograph records where indicated.

* - Subdivisions 8 and 13 of this section are not applicable to restricted blasters.

SECTION F-3008.0. STANDARDS FOR CONTROL OF AIRBLAST AND GROUND VIBRATION.

F-3008.1. Airblast. This section shall apply to airblast effects as recorded at the location of any private dwelling, public building, school, church, and community or institutional building not owned or leased by the person conducting or contracting for the blasting operation. If requested by a property owner registering a complaint and deemed necessary by the fire official, measurements of three consecutive blasts, using approved instrumentation, shall be made near the structure in question.

F-3008.1.1. Maximum airblast. The maximum airblast at any inhabited building, resulting from blasting operations, shall not exceed 130 decibels peak, or 140 decibels peak at any uninhabited building, when measured by an instrument having a flat frequency response (+3 decibels) over a range of at least 6 to 200 Hertz.

F-3008.2. Ground vibration. This section shall provide for limiting ground vibrations at structures that are neither owned nor leased by the person conducting or contracting for the blasting operation. Engineered structures may safely withstand higher vibration levels based on an approved engineering study upon which such engineered structures.

Note: Each Table, F-3008A to F-3008C, has an increasing degree of sophistication on each can be implemented either by the fire official as a result of complaints or by the contractor to determine site specific vibration limits. The criteria in Table F-3008 A, B and C and Section F-3008.3 are intended to protect low-rise structures including dwellings.

Table F-3008 A* CHARGE WEIGHT PER DELAY DEPENDENT ON DISTANCE

Distance to a Building		Weight of Explosive per Delay	Distance to a Building		Weight of Explosive per Delay	Distance to a Building		Weight of Explosive per Delay
Feet over	Feet not over	Pounds	Feet over	Feet not over	Pounds	Feet over	Feet not over	Pounds
0	5	1/4	160	170	23 1/4	400	450	98
5	10	1/2	170	180	25	450	500	115
10	15	3/4	180	190	28	500	550	135
15	60	Note b	190	200	30 1/2	550	600	155
60	70	6	200	220	34	600	650	175
70	80	7 1/4	220	240	39	650	700	195
80	90	9	240	250	42	700	750	220
90	100	10 1/2	250	260	45	750	800	240
100	110	12	260	280	49	800	850	263
110	120	13 3/4	280	300	55	850	900	288
120	130	15 1/2	300	325	61	900	950	313
130	140	17 1/2	325	350	69	950	1000	340
140	150	19 1/2	350	375	79	1000	1100	375
150	160	21 1/2	375	400	85	1100	1200	435
						1200	1300	493

Note a. Over 60 feet this table is based upon the formula: $w = d^{1.5}/90$.


Note b. One tenth of a pound of explosive per foot of distance to a building.

Table F-3008 B PEAK PARTICLE VELOCITY DEPENDENT ON DISTANCE

Distance		Peak Particle Velocity of Any One Component
Feet over	Feet not over	Inches per second
0	100	2.00
100	500	1.50
500	1000	1.00
over	1000	0.75

Note a. The instrument's transducer shall be firmly coupled to the ground

Table F-3008 C PARTICLE VELOCITY CRITERIA DEPENDENT ON FREQUENCY CONTENT

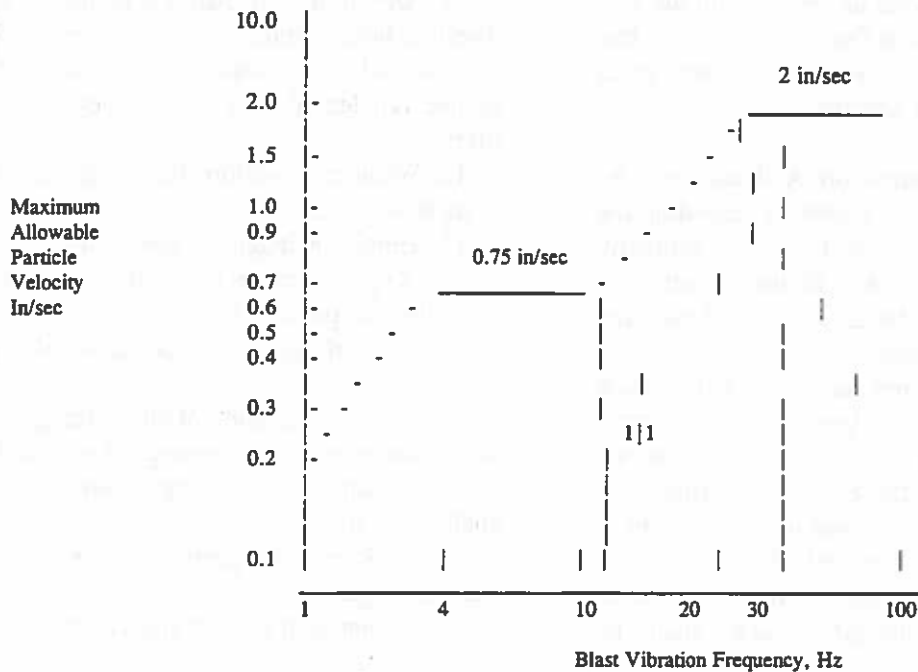

ADDENDUM

Note: This criteria is derived from the U.S. Bureau of Mines - RI 8507 (Appendix B) and provides a continuously variable particle velocity criteria dependent on the frequency content of the ground motion. The method of analysis shall be approved by the Fire Official and shall provide an analysis showing all the frequencies present over the 1 -50 Hertz range.

F-3008.2.1. Blasting without instrumentation.

Where no seismograph is used to record vibration effects, the explosive charge weight per delay (8 milliseconds or greater) shall not exceed the limits shown in Table F-3008A. When charge weights per delay on any single delay period exceed 520 lbs., then ground vibration limits for structures shall comply with Tables F-3008B, F-3008C, or Section F-3008.3.

F3008.2.2. Monitoring with instrumentation.

Where a blaster determines that the charge weights per delay given in Table F-3008A are too conservative, he may choose to monitor (at the closest conventional structure) each blast with an approved seismograph and conform to the limits set by Tables F-3008B, F-3008C, or Section F-3008.3.

Note: From this point on, the explosive charge weight per delay may be increased, but the vibration levels detailed in Tables F-3008B, F-3008C, or Section F-3008.3 shall not be exceeded.

F-3008.3. Response spectra. A relative velocity of 1.5 inches per second or less, within the 4 to 12 Hertz range of natural frequencies for low rise structures, shall be recorded as determined from an approved response spectra.

F-3008.4. Instrumentation A direct velocity recording seismograph capable of recording the continuous wave from of the three mutually perpendicular components of motion, in terms of particle velocity, shall be used and shall have the following characteristics:

1. Each seismograph shall have a frequency response from 2 to 150 Hertz or greater and a velocity range from 0.0 to 2.0 inches per second or greater and shall adhere to design criteria for portable seismographs outlined in U.S. Bureau of Mines RI5708, RI6487 and RI8506.

2. All field seismographs shall be capable of internal dynamic calibration and shall be

calibrated according to the manufacturers' specifications at least once per year.

3. All seismographs shall be operated by competent people trained in their correct use and seismographs records shall be analyzed and interpreted as may be required by the fire official.

F-3008.5. Seismographic records. A record of each blast shall be kept. All records, including seismograph reports, shall be retained for at least three years and shall be available for inspection. Records shall include the following information:

1. Name of company or contractor.
2. Location, date and time of blast.
3. Name, signature and social security number of blaster in charge.
4. Type of material blasted.
5. Number of holes bored and spacing.
6. Diameter and depth of holes.
7. Type of explosives used.
8. Total amount of explosives used.
9. Maximum amount of explosives per delay period of 8 milliseconds or greater.
10. Method of firing and type of circuit.
11. Direction and distance in feet to nearest dwelling house, public building, school, church, commercial or institutional building neither owned nor leased by the person conducting the blasting.
12. Weather conditions including such factors as wind direction, etc.
13. Height or length of stemming.
14. Type of protection, such as mats, that were used to prevent flyrock.
15. Type of detonators used and delay period used.
16. The exact location of the seismograph, and the distance of the seismograph from the blast.
17. Seismograph readings, where required, shall contain:
 - a. Name and signature of person operating the seismograph.
 - b. Name of person analyzing the

seismograph records.

c. Seismograph reading.

18. The maximum number of holes per delay period of 8 milliseconds or greater.

**SECTION F-3009.1. THEFT,
DISAPPEARANCE, INJURIES OR
PROPERTY DAMAGE.**

F-3009.1. Reports of stolen explosives. Pursuant to Section 27-97.1 of the Code of Virginia, any person holding a permit for the manufacture, storage, handling, use or sale of explosives issued in accordance with this code shall report to the State Police and the local law enforcement agency any theft or other disappearance of any explosives or blasting devices from their inventory. In addition, notification shall be made to the fire official having issued the permit.

F-3009.2. Reports of injuries or property damage. The fire official shall be immediately notified of injuries to any person or damage to any property as a result of the functioning of the explosive.

F-3009.3. Relationship of local fire official and State Fire Marshal. The local fire official shall relay information obtained from reports required by Sections F-3009.1 and F-3009.2 to the Office of the State Fire Marshal.

CHAPTER 31. FIREWORKS.

A. Change Section F-3101.1 to read:

F-3101.1. Scope. The manufacture, transportation, display, sale or discharge of fireworks shall comply with the requirements of Chapter 11 of Title 59 of the Code of Virginia.

B. Delete Section F-3102.0, Definitions.

C. Delete Section F-3103.1, General.

D. Delete Section F-3103.2, Violations.

E. Delete Section F-3103.3, Display, and renumber subsection F-3103.3.1 to F-3103.3.

F. Delete Section F-3103.5, Sale of fireworks.

**CHAPTER 32. FLAMMABLE AND
COMBUSTIBLE LIQUIDS.**

A. Change Section F-3205.5 to read as follows:

F-3205.5. Fuel dispensing outside the building. Fuel dispensers outside the building shall be located a minimum of 10 feet (3048 mm) from the lot line and five feet (1524 mm) from any building opening. Where fuel is dispensed to motor vehicles, the motor vehicle being served shall be located on the premises.

B. Change Section F-3205.8. Attendant, to read as follows:

F-3205.8 Attendant: Each service station open to the public shall have an attendant on duty who is familiar with the location of pump controls and operation of safety equipment.

Exception: Service stations in compliance with National Fire Protection Association (NFPA) 30A Standard listed in Chapter 44 shall not be required to have an attendant on duty.

Note: NFPA 30A Standard may be obtained from: National Fire Protection Association
Batterymarch Park
Quincy, MA 02269

**CHAPTER 36
LIQUEFIED PETROLEUM GASES.**

Change Section F-3601.1 as follows and delete the remainder of Chapter 36:

F-3601.1. Scope. The equipment, processes and operation for storage, handling, transporting by tank truck or tank trailer, and utilizing LP gases for fuel purposes, and for odorization of LP gases shall comply with the Virginia Liquefied Petroleum Gas Regulations in effect at the time of construction as provided for in Chapter 7, Title 27 of the Code of Virginia.

DIVISION II.

VIRGINIA UNIFORM STATEWIDE BUILDING CODE, VOLUME II - BUILDING MAINTENANCE CODE.

CHAPTER 1. ADMINISTRATION.

SECTION 100.0. GENERAL.

100.1. Title: These regulations shall be known as Volume II - Building Maintenance Code of the 1993 Edition of the Virginia Uniform Statewide Building Code (USBC). Except as otherwise indicated, Building Maintenance Code (BMC) or code, shall mean Volume II - Building Maintenance Code of the 1993 edition of the USBC.

Note: See Volume I - New Construction Code of the USBC for regulations applicable to new construction.

100.2. Authority: The Building Maintenance Code is adopted according to regulatory authority granted the Board of Housing and Community Development by the Uniform Statewide Building Code Law, Chapter 6 Title 36, Code of Virginia.

100.3. Adoption: The Building Maintenance Code was adopted by order of the Board of Housing and Community Development on December 13, 1993. This order was prepared according to the requirements of the Administrative Process Act. The order is maintained as part of the records of the Department of Housing and Community Development, and is available for public inspection.

100.4. Effective date: The Building Maintenance Code shall become effective on April 1, 1994.

100.5. Effect on other codes: The Building Maintenance Code shall apply to all buildings and structures as defined in the Uniform Statewide Building Code Law, Chapter 6 (§ 36-97 et seq.) of Title 36 of the Code of Virginia. The Building Maintenance Code supersedes all building maintenance codes and regulations of the counties, municipalities, political subdivisions and state agencies that have been or may be enacted or adopted, except as modified by Section 100.6, below.

Note: This will not prevent adoption in accordance with Chapter 1 (§ 15.1-1 et seq.) of Title 15.1 of the Code of Virginia or other special or general legislation, or other requirements by local governments which do not affect the manner of construction or materials to be used in the erection, alteration, repair, maintenance or use of a building or structure.

100.6. Application to pre-USBC buildings: Buildings or portions thereof constructed, altered, converted or repaired before the effective date of the initial edition of the USBC shall be maintained in compliance with the Building Maintenance Code. No provisions of the Building Maintenance Code shall require alterations to buildings or equipment unless an unsafe or unhealthy condition exists.

100.6.1. Hotels and motels: Pre-USBC hotels and motels shall also comply with applicable provisions of Section 108.0.

100.6.2. Nursing Homes and Homes for Adults: Pre-USBC nursing homes licensed by the Virginia Department of Health, and pre-USBC homes for adults licensed by the Virginia Department of Social Services shall also comply with applicable provisions of Section 108.0.

100.6.3. Family day homes: Pre USBC family day homes as defined in § 63.1-195 of the Code of Virginia shall comply with the applicable provisions of Section 108.0.

NOTE: As of this printing, the above section was suspended by the BHCD.

100.6.4. Hospitals: Pre-USBC hospitals shall also comply with applicable provisions of Section 108.0.

100.7. Application to post-USBC buildings: Buildings or portions thereof that were subject to the USBC when constructed, altered, converted or repaired shall be maintained in compliance with the Building Maintenance Code and with the edition of the USBC that was in effect at that time.

100.7.1. Hotels and motels: Post-USBC hotels and motels shall also comply with applicable provisions of Section 108.8.

100.7.2. Nursing homes and homes for adults: Post-USBC nursing homes licensed by the Virginia Department of Health, and post-USBC homes for adults licensed by the Virginia Department of Social Services shall also comply with applicable provisions of Section 108.0.

100.7.3. Family day homes: Post-USBC family day homes as defined in § 63.1-195 of the Code of Virginia shall comply with the applicable provisions of Section 108.0.

NOTE: As of this printing, the above section was suspended by the BHCD.

100.7.4. Hospitals: Post-USBC hospitals shall also comply with applicable provisions of section 108.0.

100.8. Exemptions for certain equipment: The provisions of the Building Maintenance Code shall not apply to equipment installed by a provider of publicly regulated utility services, or to electrical equipment used for radio and television transmission. The exempt equipment shall be under the exclusive control of the public service agency and located on property by established rights.

Exception: Buildings or service equipment associated with the exempt equipment.

100.9. Exemptions for farm structures: Farm structures not used for residential purposes shall be exempt from the provisions of the Building Maintenance Code.

Exception: Farm structures lying within a flood plain or in a mudslide prone area shall be subject to floodproofing regulations or mudslide regulations, as applicable.

100.10. Purpose: The purpose of the Building Maintenance Code is to ensure public safety, health and welfare through proper building maintenance and use and continued compliance with minimum standards of building construction, energy conservation, water conservation, and physically handicapped and aged accessibility. Proper building maintenance shall be deemed to

include the maintenance and inspection of building equipment defined by § 36-97(13) of the Code of Virginia.

SECTION 101.0. REQUIREMENTS.

101.1. Adoption of model code: The following model code, as amended by Sections 101.2 and 101.3, is hereby adopted and incorporated in the Building Maintenance Code.

THE BOCA NATIONAL PROPERTY MAINTENANCE CODE/1993 EDITION

Published by:

Building Officials and Code Administrators International, Inc.

4051 West Flossmoor Road

Country Club Hills, Illinois 60478-5795

101.2. Administrative and enforcement amendments to the referenced model code: All requirements of the referenced model code and of standards referenced therein that relate to administrative and enforcement matters are deleted and replaced by Chapter 1 of the Building Maintenance Code.

101.3. Other amendments to the referenced model code: The amendments noted in Addendum 1 shall be made to the specified chapters and sections of the BOCA National Property Maintenance Code/1993 Edition for use as part of this code.

101.4. Limitation of application of model code: No provision of the model code may be used to require alterations to the design or equipment of any portion of a building that was subject to the USBC when constructed, altered or converted as to use group, and which is occupied in accordance with the certificate of occupancy issued under the applicable edition of the USBC. In the application of the model code to other buildings, no requirement of the current edition of Volume I, New Construction Code of the USBC shall be exceeded.

SECTION 102.0.

LOCAL ENFORCING AGENCY.

102.1. Enforcement by local governments: Any local government may, after official action,

enforce the Building Maintenance Code, or any portion of the code. The local governing body may assign responsibility for enforcement of the Building Maintenance Code, or any portion thereof, to a local agency or agencies of its choice. The terms "enforcing agency" and "code official" are intended to apply to the agency or agencies to which responsibility for enforcement has been assigned. The terms "building official" or "building department" apply only to the local building official or building department.

102.2. Right of inspection: The local governing body may inspect existing buildings to enforce the Building Maintenance Code, as authorized by § 36-105 of the Code of Virginia.

102.3. Interagency coordination: When enforcement of any portion of the Building Maintenance Code is assigned to an agency other than the building department, that agency shall coordinate its reports of inspection with the building department. All required alterations, repairs, installations or constructions shall be subject to the building permit and certificate of use and occupancy provisions of Volume I of the USBC.

102.4. Code official: Each local enforcing agency shall have an executive official in charge, hereinafter referred to as the code official.

102.4.1. Appointment: The code official shall be appointed in a manner selected by the local government having jurisdiction. The local government shall notify the Training and Certification Office within 30 days of the appointment or release of the code official. The code official shall complete an orientation course approved by the Department of Housing and Community Development within 90 days of appointment.

102.4.2. Qualifications: The code official shall have at least five years of experience as a licensed professional engineer, building inspector, fire inspector, housing inspector, contractor or superintendent of building construction, with at least three years in responsible charge of work, or shall have any combination of education and experience which

would confer equivalent knowledge and ability. The code official shall have general knowledge with respect to the design and construction of buildings, the basic principles of fire prevention, plumbing, electrical and mechanical systems, building safety, and other accepted requirements for the health, safety and general welfare of the occupants and the public. The local governing body may establish additional qualification requirements.

102.4.3. Certification: The code official shall be certified in accordance with the Virginia Certification Standards (VR 394-01-2) within three years from the date of employment.

Exception: An individual employed as the code official in any locality in Virginia prior to April 1, 1995, shall be exempt from certification while employed as the code official in that jurisdiction. This exemption shall not apply to subsequent employment in another jurisdiction.

102.5. Qualifications of technical assistants: A technical assistant shall have at least three years in general building construction, building, fire or housing inspections, and general knowledge of plumbing, electrical and mechanical systems. Any combination of education and experience which would confer equivalent knowledge and ability shall be deemed to satisfy this requirement. The local governing body may establish additional qualification requirements.

102.5.1. Certification of technical assistants: Any person employed by, or under contract to, a local enforcing agency for determining compliance with the Building Maintenance Code shall be certified in accordance with the Virginia Certification Standards (VR 394-01-2) within three years from the date of employment.

Exception: An individual employed as the technical assistant in any locality in Virginia prior to April 1, 1995 shall be exempt from certification while employed as the technical assistant in that jurisdiction. This exemption shall not apply to subsequent employment in another jurisdiction.

102.6. Relief from personal responsibility: The local enforcing agency personnel shall not be

personally liable for any damages sustained by any person in excess of the policy limits of errors and omissions insurance, or other equivalent insurance obtained by the locality to insure against any action that may occur to persons or property as a result of any act required or permitted in the discharge of official duties while assigned to the department as employees. The code official or the code official's subordinates shall not be personally liable for costs in any action, suit or proceedings that may be instituted in pursuance of the provisions of the USBC as a result of any act required or permitted in the discharge of official duties while assigned to the enforcing agency as employees, whether or not said costs are covered by insurance. Any suit instituted against any officer or employee because of an act performed by such officer or employee in the discharge of official duties and under the provisions of the Building Maintenance Code may be defended by the enforcing agency's legal representative.

102.7. Control of conflict of interest: The minimum standards of conduct for officials and employees of the enforcing agency shall be in accordance with the provisions of the State and Local Government Conflict of Interests Act (§ 2.1-639.1 et seq. of the Code of Virginia).

SECTION 103.0. DUTIES AND POWERS OF THE CODE OFFICIAL.

103.1. General: The code official shall enforce the provisions of the Building Maintenance Code as provided herein and as interpreted by the State Building Code Technical Review Board in accordance with § 36-118 of the Code of Virginia.

Note: Section 36-105 of the Code of Virginia provides that fees may be levied by the local governing body in order to defray the cost of enforcement and appeals.

103.2. Notices and orders: The code official shall issue all necessary notices or orders to ensure compliance with the requirements of this code for the health, safety and general welfare of the public.

103.3. Delegation of duties and powers: The

code official may delegate duties and powers subject to any limitations imposed by the local government, but shall be responsible that any powers and duties delegated are carried out in accordance with the code.

103.4. Modifications: The code official may grant modifications to any of the provisions of this code upon application by the owner or the owner's agent provided the spirit and intent of the Building Maintenance Code are observed and public health, welfare, and safety are assured. A copy of the application for a modification and a copy of the final decision of the code official shall be kept in the permanent records of the enforcing agency.

103.5. Unsafe conditions not related to maintenance: When the code official finds a condition that constitutes a serious and dangerous hazard to life or health in a building which was constructed, altered, converted, or repaired before the effective date of the initial edition of the USBC, and when such condition was not caused by faulty maintenance, or by failure to comply with the applicable state and local regulations that were in effect at the time, the official may order the minimum changes needed to remedy the hazardous condition.

Note: The Building Maintenance Code does not generally provide for retrofitting existing buildings. However, conditions may exist in older buildings, because of faulty design or equipment, that constitute such serious and dangerous hazards that correction is necessary to protect life and health. It is not the intent of this section that such changes comply fully with the requirements of the current edition of the USBC. Only those changes that are needed to remedy the serious and dangerous hazards to life or health may be required by the code official. Reference is also made to Section 103.2 of the administrative provisions of Volume I of the USBC, which provides authority for modifications to be issued for alternate means to be used that provide the same level of safety.

103.6. Enforcing agency records: The code official shall keep records of reports of inspections, notices and orders issued and such other matters as directed by the local

government. Records may be disposed of in accordance with the provisions of the Virginia Public Records Act (§ 42.1-76 et seq. of the Code of Virginia), (a) after one year in the case of buildings under 1,000 square feet in area and one and two family dwellings of any area, and (b) after three years in the case of all other buildings.

SECTION 104.0. VIOLATIONS.

104.1. Code violations prohibited: Buildings and equipment in violation of the provisions of this code shall not be used except as approved by the code official.

104.2. Notice of violation: The code official shall serve a notice of violation on the person responsible for maintenance or use of a building in violation of the provisions of this code. Such order shall reference the code section that serves as a basis for the violation and specify a time limit for the discontinuance or abatement of the violation. Such notice of violation shall be in writing, and be served by either delivering a copy of the notice to such person by mail to the last known post office address, delivering in person or by delivering it to and leaving it in the possession of any person in charge of the premises, or by posting the notice in a conspicuous place at the entrance door or accessway if such person cannot be found on the premises.

104.3. Prosecution of violation: If the notice of violation is not complied with, the code official shall request, in writing, the legal counsel of the jurisdiction to institute the appropriate legal proceedings to restrain, correct or abate such violation; or to require the removal or termination of the use of the building in violation of the provisions of this code.

104.4. Violation penalties: Violations of this code are a misdemeanor in accordance with § 36-106 of the Code of Virginia, and upon conviction, may be punished by a fine of not more than \$2,500.

104.5. Abatement of violation: Conviction of a violation of this code shall not preclude the

institution of appropriate legal action to require correction or abatement of the violation or to prevent other violations or recurring violations of this code relating to maintenance and use of the building or premises.

104.6. Suspension or revocation of certificate of occupancy: The code official may suspend or revoke the certificate of occupancy for failure to correct repeated violations in apparent disregard for the provisions of the USBC.

SECTION 105.0. UNSAFE BUILDINGS.

105.1. General: This section shall apply to buildings and their equipment that fail to comply with the Building Maintenance Code through damage, deterioration, infestation, improper maintenance, or for other reasons, and thereby become unsafe, unsanitary, or deficient in adequate exit facilities, or which constitute a hazard or public nuisance, or are otherwise dangerous to human life, health or safety, or the public welfare. All such buildings or other structures declared by the code official to be a public nuisance or unfit for human habitation shall either be: made safe through compliance with this code, or be vacated and secured against public entry, or taken down and removed as determined by the code official. A vacant building, unsecured or open at door or window, may be deemed a fire hazard and unsafe within the meaning of this section.

105.2. Inspection of unsafe buildings: The code official shall examine any building reported as unsafe, and shall prepare a report to be filed in the records of the enforcing agency. In addition to a description of unsafe conditions found, the report shall include the use of the building, and nature and extent of damages, if any, caused by a collapse or failure.

105.3. Notice of unsafe buildings: If a building is found to be unsafe, the code official shall serve a notice to the owner, the owner's agent or person in control of the unsafe building. The notice shall specify the required repairs or improvements to be made to the building, or require the unsafe building, or portion of the building to be taken down and removed within a

stipulated time. Such notice shall require the person notified to declare to the designated official without delay acceptance or rejection of the terms of the notice.

Note: Whenever possible, the notice of unsafe building should also be given to the tenants of the unsafe building.

105.4. Posting of unsafe building notice: If the person named in the notice of an unsafe building cannot be found, the notice shall be sent by registered or certified mail to the last known address of such person. A copy of the notice shall be posted in a conspicuous place on the premises. Such procedure shall be deemed the equivalent of personal notice.

105.5. Disregard of notice: If the person served with a notice of unsafe building refuses or neglects to comply with requirements of the notice to abate the unsafe condition, the code official may revoke the certificate of occupancy. In the case of a vacant building, including one vacated through revocation of the certificate of occupancy, the code official may cause the building to be closed through any available means.

105.6. Authority to vacate building: When in the opinion of the code official, there is actual and immediate danger of failure or collapse of a building or any part of a building which would endanger life; or when any building or part of a building has fallen and life is endangered by occupancy of the building; or when any other hazardous condition poses an immediate and serious threat to life; or when a building or other structure is declared a public nuisance, or unfit for human habitation, the code official may order the occupants to vacate the building. The code official shall post a notice at each entrance to such building that reads: "THIS STRUCTURE IS UNSAFE OR UNFIT FOR HABITATION AND ITS USE OR OCCUPANCY HAS BEEN PROHIBITED BY THE CODE OFFICIAL". Upon the posting of the notice, no person shall enter such a building except upon authorization of the code official for one of the following purposes: (i) to make the required repairs; (ii) to take the building down and remove it; or (iii) to make inspections.

105.7. Temporary safeguards and emergency repairs: When, in the opinion of the code official, there is immediate danger of collapse or failure of a building or any part of a building which would endanger life, or when a violation of this code results in a hazard that creates an immediate, serious and imminent threat to the life and safety of the occupants, the code official shall have the necessary work done to the extent permitted by the local government to make such building or part of the building temporarily safe, whether or not legal action to force compliance has begun.

105.8. Abatement or removal: Whenever the owner of a building or structure that has been deemed to be a public nuisance pursuant to Section 105.1 fails to comply with the requirements of the notice to abate, the code official may cause the building to be razed or removed.

Note: A local governing body may, after official action pursuant to § 15.1-29.21 or 15.1-11.2 of the Code of Virginia, maintain an action to compel a responsible party to abate, raze, or remove a public nuisance. If the public nuisance presents an imminent and immediate threat to life or property, then the governing body of the county, city or town may abate, raze, or remove such public nuisance, and a county, city or town may bring an action against the responsible party to recover the necessary costs incurred for the provision of public emergency services reasonably required to abate any such public nuisance.

SECTION 106.0. APPEALS.

106.1. Local Board of Building Code Appeals (BBCA): Each jurisdiction shall have a BBCA to hear appeals as authorized herein or it shall enter into an agreement with the governing body of another county or municipality or with some other agency, or a state agency approved by the Department of Housing and Community Development, to act on appeals. The jurisdiction may have separate BBCA's provided that each BBCA complies with this section. An appeal case decided by a separate BBCA shall constitute an appeal in accordance with this section and shall be final unless appealed to the State

Building Code Technical Review Board (TRB).

106.2. Membership of BBCA: The BBCA shall consist of at least five members appointed by the jurisdiction and who shall have terms of office established by written policy. Alternate members may be appointed to serve in the absence of any regular members and, as such, shall have the full power and authority of the regular members. Regular and alternate members may be reappointed. Written records of current membership, including a record of the current chairman and secretary, shall be maintained in the office of the jurisdiction. In order to provide continuity, the terms of the members may be of different length so that less than half will expire in any one-year period.

106.2.1. Chairman: The BBCA shall annually select one of its regular members to serve as chairman. In the event of the absence of the chairman at a hearing, the members present shall select an acting chairman.

106.2.2. Secretary: The jurisdiction shall appoint a secretary to the BBCA to maintain a detailed record of all proceedings.

106.3. Qualifications of BBCA members: BBCA members shall be selected by the jurisdiction on the basis of their ability to render fair and competent decisions regarding application of the USBC and shall, to the extent possible, represent different occupational or professional fields relating to the construction industry. Employees or officials of the jurisdiction shall not serve as members of the BBCA. At least one member should be an experienced builder and one member a licensed professional engineer or architect.

106.4. Disqualification of member: A member shall not hear an appeal in which that member has a conflict of interest in accordance with the State and Local Government Conflict of Interests Act, Chapter 40.1 (§ 2.1-639.1 et esq.) of Title 2.1 of the Code of Virginia.

106.5. Application for appeal: The owner of a building or structure or the owner's agent may appeal a decision of the code official concerning

the application of the BMC or his refusal to grant a modification to the provisions of the BMC covering the manner of maintenance or use or the materials to be used in the maintenance or repair of that building or structure. The applicant shall submit a written request for appeal to the BBCA within 21 calendar days from the receipt of the decision to be appealed. The application shall contain the name and address of the owner of the building or structure and the person appealing if not the owner. A copy of the written decision of the code official shall be submitted along with the application for appeal and maintained as part of the record. The application shall be stamped or otherwise marked by the BBCA to indicate the date received. Failure to submit an application for appeal within the time limit established by this section shall constitute acceptance of the code official's decision.

106.6. Notice of meeting: The BBCA shall meet within 30 calendar days after the date of receipt of the application for appeal. Notice indicating the time and place of the hearing shall be sent to the parties in writing to the addresses listed on the application at least 14 calendar days prior to the date of the hearing. Less notice may be given if agreed upon by the applicant.

106.7. Hearing procedures: All hearings before the BBCA shall be open to the public. The appellant, the appellant's representative, the jurisdiction's representative and any person whose interests are affected shall be given an opportunity to be heard. The chairman shall have the power and duty to direct the hearing, rule upon the acceptance of evidence and oversee the record of all proceedings.

106.7.1. Postponement: When five members of the BBCA are not present to hear an appeal, either the appellant or the appellant's representative shall have the right to request a postponement of the hearing. The BBCA shall reschedule the appeal within 30 calendar days of the postponement.

106.8. Decision: The BBCA shall have the power to reverse or modify the decision of the code official by a concurring vote of a majority of those present.

106.8.1. Resolution: The decision of the BBCA shall be by resolution signed by the chairman and retained as part of the record by the BBCA. The following wording shall be part of the resolution:

"Upon receipt of this resolution, any person who was a party to the appeal may appeal to the State Building Code Technical Review Board by submitting an application to the State Building Code Technical Review Board within 21 calendar days. Application forms are available from the Office of the State Building Code Technical Review Board, 501 North Second Street, Richmond, Virginia 23219, (804) 371-7170." Copies of the resolution shall be furnished to all parties.

106.9. Appeal to the State Building Code Technical Review Board (TRB): After final determination by the BBCA, any person who was a party to the local appeal may appeal to the TRB. Application shall be made to the TRB within 21 calendar days of receipt of the decision to be appealed. Failure to submit an application for appeal within the time limit established by this section shall constitute an acceptance of the BBCA's resolution.

106.9.1. Information to be submitted: Copies of the decision of the code official and the resolution of the BBCA shall be submitted with the application for appeal. Upon request by the Office of the TRB, the jurisdiction shall submit a copy of all pertinent information from the record of the BBCA.

106.9.2. Decision of TRB: Procedures of the TRB are in accordance with Article 2 (§ 36-108 et seq.) of Chapter 6 of Title 36 of the Code of Virginia. Decisions of the TRB shall be final if no appeal is made therefrom and the code official shall take action accordingly.

SECTION 107.0. DEMOLITION OF BUILDINGS.

107.1. Procedures for demolition: Whenever a building is to be demolished pursuant to any provision of this code, the work shall be carried out in compliance with the requirements of Volume I of the USBC.

SECTION 108.0. SPECIAL PROVISIONS.

108.1. General: The provisions of this section contain requirements for improving the safety of certain buildings by requiring the installation of materials or equipment not originally required. Unless otherwise noted, these provisions shall apply equally to both pre- and post-USBC buildings.

108.2. Hotels and motels: Existing hotels and motels shall comply with the provisions of this section.

108.2.1. Fire sprinkler system: An automatic sprinkler system meeting the requirements of the USBC, Volume I, 1987 Edition, Second Amendment (effective date March 1, 1990), for Use Group R-1, shall be installed throughout existing hotels and motels by either March 1, 1997, or within seven years of the date upon which an adequate water supply is made available to meet the needs of the suppression system, whichever is later.

Exceptions: 1. Hotels and motels that are equipped throughout with an automatic sprinkler system.

2. Hotels and motels which are three stories or less in height.

108.2.2. Single and multiple station smoke detectors: Single and multiple station smoke detectors meeting the requirements of the USBC, Volume I, 1987 Edition, Second Amendment, for Use Group R-1, shall be installed in existing hotels and motels.

Exception: Hotels and motels that are equipped throughout with single and multiple station smoke detectors.

108.3. Nursing homes and nursing facilities: Existing nursing homes and nursing facilities licensed by the Virginia Department of Health shall comply with the provisions of this section.

108.3.1. Automatic sprinkler system: An automatic sprinkler system meeting the requirements of the USBC, Volume I, 1987 Edition, Third Amendment (effective date October 1, 1990), for Use Group I-2, shall be installed in existing nursing homes and nursing

facilities, as follows:

1. NFIPA 13D Standard for one story buildings.
2. NFIPA 13R Standard for buildings two or three stories in height.
3. NFIPA 13 Standard for buildings four or more stories in height.

Exceptions: 1. Nursing homes and nursing facilities which are equipped throughout with an automatic sprinkler system.

2. Nursing facilities consisting of certified long-term care beds located on the ground floor of general hospitals.

108.3.1.1. Quick response sprinklers: Quick response sprinklers shall be installed in patient sleeping rooms of buildings subject to Section 108.3.1.

108.3.1.2. Exceptions provided for: Buildings equipped throughout with an automatic fire sprinkler system meeting the requirements of NFIPA 13 shall be permitted to use the exceptions provided in the USBC, Volume I, 1987 Edition, Third Amendment including, but not limited to, the following:

1. Section 502.3 (Area Increase)
2. Section 503.1 (Height Increase)
3. Section 610 (Use Group I-2 Areas)
4. Section 807 (Types and Location of Means of Egress)
5. Section 808 (Capacity of Egress Components)
6. Section 809 (Number of Exits)
7. Section 810 (Exit Access Passageways and Corridors)
8. Section 921 (Firestopping and Draftstopping)

108.3.2. Fire protective signaling system: A fire protective signaling system meeting the requirements of the USBC, Volume I, 1987 Edition, Third Amendment, for Use Group I-2, shall be installed in existing nursing homes and nursing facilities by August 1, 1994.

Exception: Nursing homes and nursing facilities that are equipped throughout with an automatic fire protective signaling system.

108.3.3. Fire detection system: An automatic fire detection system meeting the requirements of

the USBC, Volume I, 1987 Edition, Third Amendment, for Use Group I-2, shall be installed in existing nursing homes and nursing facilities by August 1, 1994.

108.3.3.1. Fire detection system in existing sprinklered facilities: Nursing homes and nursing facilities that are exempt from Section 108.3.1 because of an existing automatic sprinkler system shall install a fire detection system meeting the requirements of the USBC, Volume I, 1987 Edition, Second Amendment, for Use Group I-2.

108.4. Homes for Adults: Existing Homes for Adults licensed by the Virginia Department of Social Services shall comply with this section.

108.4.1. Fire protective signaling system and fire detection system: A fire protective signaling system and an automatic fire detection system meeting the requirements of the USBC, Volume I, 1987 Edition, Third Amendment, shall be installed in Homes for Adults by August 1, 1994.

Exception: Homes for Adults that are equipped throughout with a fire protective signaling system and an automatic fire detection system.

108.4.2. Single and multiple station smoke detectors: Battery or AC-powered single and multiple station smoke detectors meeting the requirements of the USBC, Volume I, 1987 Edition, Third Amendment, shall be installed in Homes for Adults by August 1, 1994.

Exception: Homes for adults that are equipped throughout with single and multiple station smoke detectors.

108.5. Identification of handicapped parking spaces: All spaces reserved for the use of handicapped persons shall be identified by an above grade sign with the bottom edge no lower than four feet nor higher than seven feet above the parking surface. Such signs shall be installed in accordance with applicable provisions of the current edition of Volume I of the USBC.

108.6. Family day homes: Family Day Homes as defined in § 63.1-195 of the Code of Virginia

shall be provided with at least one exterior exit door from each floor used for the care of children.

NOTE: As of this printing, the above section was suspended by the BHCD.

108.7. Hospitals: Existing hospitals licensed by the Virginia Department of Health shall comply with this section.

108.7.1. Fire sprinkler system: An automatic sprinkler system meeting the requirements of National Fire Protection Association Standard 13-91, listed in USBC, Volume I (13 VAC 5-60-10 et seq.), Chapter 35, shall be provided in existing hospitals by January 1, 1998.

Exceptions: 1. The Commissioner of the Virginia Department of Health may, at his discretion, extend the time for compliance with this section for any hospital that can demonstrate its inability to comply, if such hospital submits, prior to January 1, 1998, a plan for compliance by a date certain which shall be no later than July 1, 1998.

2. Any hospital located in a city having a population of more than 16,100 but less than 18,000, or in a county having a population of

more than 17,350, but less than 17,500, may submit a plan of compliance by a date certain which shall be no later than July 1, 2003.

3. Hospitals that are equipped throughout with a sprinkler system are exempt from this section.

108.7.1.1. Areas of protection: Sprinkler protection shall only be required in patient sleeping rooms, operating and emergency treatment rooms and spaces adjoining such rooms. The area of protection shall extend to an approved smoke barrier or a minimum one-half hour rated assembly. The one-half hour rated assembly shall have self-closing doors and shall be continuous from floor slab to floor or roof deck above.

108.7.1.2. Sprinkler: Patient sleeping rooms shall be provided with quick response sprinklers.

108.7.1.3. Water-control valves: All valves in water supply pipes to sprinkler systems, except underground valves in roadway boxes, shall be supervised open with an audible and visual alarm to signal at a constantly attended location.

AMENDMENTS TO THE BOCA NATIONAL PROPERTY MAINTENANCE CODE/1993 EDITION.

As provided in Section 101.3 of Volume II - Building Maintenance Code of the 1993 edition of the USBC, the amendments noted in this Addendum shall be made to the BOCA National Property Maintenance Code/1993 edition for use as part of the Building Maintenance Code.

CHAPTER 1.

ADMINISTRATION AND ENFORCEMENT.

Chapter 1, Administration and Enforcement, is deleted in its entirety and replaced with Chapter 1 of the Building Maintenance Code.

CHAPTER 3.

ENVIRONMENTAL REQUIREMENTS.

(A) Delete Section PM-303.1.

(B) Delete Section PM-303.4.

(C) Delete Section PM-303.5.

(D) Delete Section PM-303.8.

Note: The above sections of this code have been deleted because the agency's Attorney General representative advises that they cannot be interpreted as building regulations under the current language of § 36-97(7) of the Code of Virginia.

(E) Change Section PM-304.1 to read:

PM-304.1. General: The exterior of all structures, occupied, vacant or otherwise, shall be maintained in good repair, structurally sound and sanitary so as not to pose a threat to the public health, safety or welfare.

(F) Change Section PM-304.12 to read:

PM-304.12. Insect screens: During the period from April 1 to December 1 every door, window and other outside opening required for ventilation purposes serving any building containing

habitable rooms, food preparation areas, food service areas, or any areas where products used in food for human consumption are processed, manufactured, packaged or stored, shall be supplied with approved tightly fitting screens of not less than 16 mesh per inch and every swinging door shall have a self-closing device in good working condition.

Exception: Screen doors shall not be required for out-swinging doors or other types of openings which make screening impractical, provided other approved means, such as air curtains or insect repellent fans are employed.

(G) Change Section PM-305.4 to read as follows: **PM-305.4. Lead-based paint:** Interior and exterior painted surfaces of dwellings, child and day care facilities, including fences and outbuildings, that contain in excess of 0.5% lead by weight shall be removed or covered in an approved manner.

(H) Delete Section PM-306.2.

(I) Delete Section PM-306.3.

CHAPTER 4. LIGHT, VENTILATION AND OCCUPANCY LIMITATIONS.

(A) Change Section PM-403.1 to read:
PM-403.1. Habitable spaces: Every habitable space shall have at least one window of approved size facing directly to the outdoors or to a court. The minimum total window area, measured between stops, for every habitable space shall be 4.0% of the floor area of such room, except in kitchens when artificial light may be provided in accordance with the provisions of the building code. Whenever walls or other portions of a structure face a window of any other room and such obstructions are located less than three feet (914 mm) from the window and extend to a level above that of the ceiling of the room, such a window shall not be deemed to face directly to the outdoors nor to a court and shall not be included as contributing to the required minimum total window area for the room.

(B) Delete Section PM-405.10.

CHAPTER 6. MECHANICAL AND ELECTRICAL REQUIREMENTS.

(A) Change Section PM-602.2 to read:

PM-602.2. Residential buildings: Every owner and operator of any building who rents, leases or lets one or more dwelling unit, rooming unit, dormitory or guest room on terms, either express or implied, to furnish heat to the occupants thereof shall supply sufficient heat during the period from October 1 to May 15 to maintain a room temperature of not less than 65°F (18°C) in all habitable rooms, bathrooms, and toilet rooms during the hours between 6:30 a.m. and 10:30 p.m. of each day and not less than 60°F (16°C) during other hours. When the outdoor temperature is below the outdoor design temperature required for the locality by the mechanical code listed in Chapter 8, the owner or operator shall not be required to maintain the minimum room temperatures, provided the heating system is operating at full capacity, with supply valves and dampers in a full open position.

(B) Delete Sections PM-602.2.1 and PM-602.2.2

(C) Change Section PM-602.3 to read:

PM-602.3. Nonresidential structures: Every owner of any structure who rents, leases, or lets the structure or any part thereof on terms, either express or implied, to furnish heat to the occupants thereof shall supply sufficient heat during the period from October 1 to May 15 to maintain a temperature of not less than 65°F (18°C) during all working hours.

Exceptions: 1. Processing, storage and operation areas that require cooling or special temperature conditions.

2. Areas in which persons are primarily engaged in vigorous physical activities.

(D) Add new Section PM-606.3 to read:
PM-606.3. Inspection: Routine and periodic inspections shall be performed in accordance with Part X of ASME A-17.1 listed in Chapter 8.

CHAPTER 7. FIRE SAFETY REQUIREMENTS.

(A) Add new Section PM-705.5.4:
PM-705.5.4. Visual and audible alarms: Visual and audible alarms meeting the requirements of ANSI/UL Standard 1638 and ANSI/NFPA 72G shall be provided in occupancies housing the hard of hearing as required by § 36-99.5 of the Code of Virginia;

however, all visual alarms shall provide a minimum intensity of 100 candela. Portable alarms meeting these requirements shall be accepted.

**CHAPTER 8.
REFERENCED STANDARDS.**

(A) Delete standard reference number BOCA NBC-93, BOCA National Building Code and substitute the Virginia Uniform Statewide Building Code, Volume I/1993 edition.

(B) Delete standard reference number BOCA NFPC-93, BOCA National Fire Prevention Code and substitute the Virginia Statewide Fire Prevention Code/1993 edition.

APPENDIXES

RELATED LAWS.

(Excerpts from the Code of Virginia)

§ 19.2-8. Limitation of prosecutions. A prosecution for a misdemeanor, or any pecuniary fine, forfeiture, penalty or amercement, shall be commenced within one year next after there was cause therefor, except that a prosecution for petit larceny may be commenced within five years, and for an attempt to produce abortion, within two years after commission of the offense. In a prosecution for violation of laws governing the placement of children for adoption without a license pursuant to § 63.1-196, no action shall be commenced after the expiration of one year from the date of the filing of the petition for adoption. A prosecution for making a false statement or representation of a material fact knowing it to be false or knowingly failing to disclose a material fact, to obtain or increase any benefit or other payment under the Virginia Unemployment Compensation Act (§ 60.2-100 et seq.) shall be commenced within three years next after the commission of the offense. A prosecution for any violation of §§ 10.1-1320, 62.1-44.32 (b), 62.1-194.1, or Article 11 (§ 62.1-44.34:14 et seq.) of Chapter 3.1 of Title 62.1 which involves the discharge, dumping or emission of any toxic substance as defined in § 32.1-239 shall be commenced within three years next after the commission of the offense. Prosecution of Building Code violations under § 36-106 shall commence within two years of discovery of the offense by the owner or by the building official; provided that such discovery occurs within one year of the date of initial occupancy or use after construction of the building or structure, or the issuance of a certificate of use and occupancy for the building or structure, whichever is later. Prosecution of nonfelonious offenses which constitute malfeasance in office shall commence within two years next after the commission of the offense. Prosecution of any violation of §§ 55-79.87, 55-79.88, 55-79.89, 55-79.90, 55-79.93, 55-79.94, 55-79.95, 55-79.103, or any rule adopted under or order issued pursuant to § 55-79.98, shall commence within three years next after the commission of the offense.

Prosecution of illegal sales or purchases of wild birds, wild animals and freshwater fish under § 29.1-553 shall commence within three years after commission of the offense. Prosecution of violations under Title 58.1 for offenses involving false or fraudulent statements, documents or returns, or for the offense of willfully attempting in any manner to evade or defeat any tax or the payment thereof, or for the offense of willfully failing to pay any tax, or willfully failing to make any return at the time or times required by law or regulations shall commence within three years next after the commission of the offense, unless a longer period is otherwise prescribed. Prosecution of violations of subsection A of § 3.1-796.122 shall commence within five years of the commission of the offense, except violations regarding agricultural animals shall commence within one year of the commission of the offense. Nothing in this section shall be construed to apply to any person fleeing from justice or concealing himself within or without this Commonwealth to avoid arrest or be construed to limit the time within which any prosecution may be commenced for desertion of a spouse or child or for neglect or refusal or failure to provide for the support and maintenance of a spouse or child.

§ 27-30. Appointment of fire marshal. An officer, who shall be called a "fire marshal," may be appointed for each county, city or town, by the governing body thereof, whenever, in the opinion of such body, the appointment shall be deemed expedient. The term "fire marshal" as used in this chapter may include the local fire official and local arson investigator when appointed pursuant to this section.

§ 27-31. Investigation of fires. Such fire marshal shall make an investigation into the origin and cause of every fire occurring within the limits for which he was appointed, and for any such service he shall receive such compensation as the governing body may allow.

§ 27-32. Summoning witnesses and taking evidence. In making such investigation the fire marshal may

APPENDIX A.

issue a summons directed to a sheriff or sergeant of any county, city or town commanding the officer to summon witnesses to attend before him at such time and place as he may direct. Any such officer to whom the summons is delivered, shall forthwith execute it, and make return thereof to the fire marshal at the time and place named therein.

Witnesses, on whom the summons before mentioned is served, may be compelled by the fire marshal to attend and give evidence, and shall be liable in like manner as if the summons had been issued by a justice of the peace in a criminal case. They shall be sworn by the fire marshal before giving evidence, and their evidence shall be reduced to writing by him, or under his direction, and subscribed by them respectively.

§ 27-32.1. Right of entry to investigate cause of fire or explosion. If in making such an investigation, the fire marshal shall make complaint under oath that there is good cause of suspicion or belief that the burning of or explosion on any land, building or vessel or of any object was caused by any act constituting a crime as defined in Article 1 (§ 18.2-77 et seq.) of Chapter 5 of Title 18.2 and that he has been refused admittance to the land, building or vessel or to examine the object in or on which any fire or explosion occurred within fifteen days after the extinguishment of such, any justice of the peace of the city or county where the land, building, vessel or object is located may issue a warrant to the sheriff of the county or the sergeant of the city requiring him to enter such land, building or vessel or the premises upon which the object is located in the company of the fire marshal for the purposes of conducting a search for evidence showing that such fire or explosion was caused by any act defined in Article 1 of Chapter 5, of Title 18.2.

§ 27-32.2. Issuance of fire investigation warrant. If, in undertaking such an investigation, the fire marshal makes an affidavit under oath that the origin or cause of any fire or explosion on any land, building, or vessel, or of any object is undetermined and that he has been refused admittance thereto, or is unable to gain permission to enter such land, building, or vessel, or to examine such object, within fifteen days after the extinguishing of such, any magistrate of the city or county where the land, building, vessel, or object is located may issue a fire investigation warrant to the fire marshal authorizing him to enter such land, building, vessel, or the premises upon which the object is located for the purpose of determining the origin and source of such fire or explosion. If the fire marshal, after gaining access to any land, building, vessel, or other premises pursuant to such a fire investigation warrant, has probable cause to believe that the burning or explosion was caused by any act

constituting a criminal offense, he shall discontinue the investigation until a search warrant has been obtained pursuant to § 27-32.1, or consent to conduct the search has otherwise been given.

§ 27-33. Report of investigation. The fire marshal shall make report to the governing body by whom he was appointed of any investigation made by him as soon thereafter as practicable, returning therewith the evidence taken by him and submitting such recommendations therein as he may think the public interest demands.

§ 27-34. Duties and powers at fires. Whenever any fire occurs, it shall be the duty of such fire marshal or his designated representative to be present at the same and advise and act in concert with such officers of police as may be present; and, for preserving order at and during the existence of such fire, and for the protection of property, he shall have concurrent powers with the officers of police, and the chief or other officer in charge, but shall not exercise any authority which will conflict with the powers of any chief or other officer in command of any fire department in the discharge of his special duties as such.

§ 27-34.1. Power of fire marshal or fire chief to take property found at scene of fire or explosion; restitution of such property. The fire chief, fire marshal or his designated representative is authorized to take and preserve any property found at the scene of a fire or explosion during his presence there while in the act of extinguishing such or found later with the consent of the owner or pursuant to § 27-32.1, which property indicates the fire or explosion was intentionally caused. Any person whose property is so taken and held may petition the circuit court of the county or city in which the property was taken or judge in vacation, for return of the property, and the court may order restitution upon such conditions as are appropriate for preservation of evidence, including the posting of bond.

§ 27-34.2. Power to arrest, to procure and serve warrants and to issue summons; limitation on authority. In addition to such other duties as may be prescribed by law, the local fire marshal and his assistants appointed pursuant to § 27-36 shall, if authorized by the governing body of the county, city or town appointing the local fire marshal, have the authority to arrest, to procure and serve warrants of arrest and to issue summons in the manner authorized by general law for violation of local fire prevention and fire safety and related ordinances. The authority granted in this section shall not be exercised by any local fire marshal or assistant until such person has satisfactorily completed a training course designed specifically for local fire marshals and their assistants,

which course shall be approved by the Virginia Fire Services Board.

The Department of Fire Programs in cooperation with the Department of Criminal Justice Services shall have the authority to design, establish and maintain the required courses of instruction through such agencies and institutions as the Departments jointly may deem appropriate and to approve such other courses as such Departments determine appropriate.

The authority granted in this section shall not be construed to authorize a fire marshal or his assistants to wear or carry firearms.

§ 27-34.2:1. Police powers of fire marshals. In addition to such other duties as may be prescribed by law, the local fire marshal and those assistants appointed pursuant to § 27-36 designated by the fire marshal shall, if authorized by the governing body of the county, city or town appointing the local fire marshal, have the same police powers as a sheriff, police officer or law-enforcement officer. The investigation and prosecution of all offenses involving fires, fire bombings, bombings, attempts or threats to commit such offenses, false alarms relating to such offenses, possession and manufacture of explosive devices, substances and fire bombs shall be the responsibility of the fire marshal or his designee, if authorized by the governing body of the county, city or town appointing the local fire marshal. The police powers granted in this section shall not be exercised by any local fire marshal or assistant until such person has satisfactorily completed a course for fire marshals with police powers, designed by the Department of Fire Programs in cooperation with the Department of Criminal Justice Services, which course shall be approved by the Virginia Fire Services Board.

In addition, fire marshals with police powers shall continue to exercise those powers only upon satisfactory participation in in-service and advanced courses and programs designed by the Department of Fire Programs in cooperation with the Department of Criminal Justice Services, which courses shall be approved by the Virginia Fire Services Board.

§ 27-34.3. Power to order immediate compliance with law, etc., or prohibit use of building or equipment. The local fire marshal shall, if authorized by the governing body of the county, city or town appointing him, have the authority to exercise the powers authorized by the Fire Prevention Code. However, an order prohibiting the use of a building or equipment - issued pursuant to this section shall not be effective beyond the date of a determination made by the authorities identified in and pursuant to § 27-97, regardless of whether or not said determination overrules, modifies or affirms the order of the local fire marshal. If an order of the local fire marshal

issued pursuant to this section conflicts to any degree with an order previously issued by an authority identified in and pursuant to § 27-97, the latter order shall prevail. The local fire marshal shall immediately report to the authorities identified in § 27-97 on the issuance and content of any order issued pursuant to this section.

§ 27-34.4. Inspection and review of plans of buildings under construction. Inspection of buildings other than state-owned buildings under construction and the review and approval of building plans for these structures for enforcement of the Uniform Statewide Building Code shall be the sole responsibility of the appropriate local building inspectors. Upon completion of such structures, responsibility for fire safety protection shall pass to the local fire marshal or official designated by the locality to enforce the Statewide Fire Prevention Code (§ 27-94 et seq.) in those localities which enforce the Statewide Fire Prevention Code.

§ 27-35. Penalty for failure to discharge duty. For his failure to discharge any duty required of him by law the fire marshal shall be liable for each offense to a fine not exceeding \$100, to be imposed by the governing body and to be collected as other fines are collected.

§ 27-36. Appointment, powers and duties of assistant fire marshals. The governing body of any county, city or town may appoint one or more assistants, who, in the absence of the fire marshal, shall have the powers and perform the duties of the fire marshal.

§ 27-37. Oath of fire marshal and assistants. The fire marshal and his assistants, before entering upon their duties, shall respectively take an oath, before any officer authorized to administer oaths, faithfully to discharge the duties of such office; the certificate of the oath shall be returned to and preserved by such governing body.

§ 27-37.1. Right of entry to investigate releases of hazardous material, hazardous waste, or regulated substances. The fire marshal shall have the right, if authorized by the governing body of the county, city, or town appointing the fire marshal, to enter upon any property from which a release of any hazardous material, hazardous waste, or regulated substance, as defined in § 10.1-1400 or § 62.1-44.34:8, has occurred or is reasonably suspected to have occurred and which has entered into the ground water, surface water or soils of the county, city or town in order to investigate the extent and cause of any such release. If, in undertaking such an investigation, the fire marshal makes an affidavit under oath that the origin or cause of any such release is undetermined and that he has been refused admittance to the property, or is

APPENDIX A.

unable to gain permission to enter the property, any magistrate of the city or county where the property is located may issue an investigation warrant to the fire marshal authorizing him to enter such property for the purpose of determining the origin and source of the release. If the fire marshal, after gaining access to any property pursuant to such investigation warrant, has probable cause to believe that the release was caused by any act constituting a criminal offense, he shall discontinue the investigation until a search warrant has been obtained or consent to conduct the search has otherwise been given.

§ 27-94. **Short title.** This chapter may be cited as the "Virginia Statewide Fire Prevention Code Act."

§ 27-95. **Definitions.** As used in this chapter, unless the context or subject matter requires otherwise, the following words or terms shall have the meaning herein ascribed to them:

"*Board*" means the Board of Housing and Community Development.

"*Code provisions*" means the provisions of the Fire Prevention Code as adopted and promulgated by the Board, and the amendments thereof as adopted and promulgated from time to time by such Board.

"*Enforcement agency*" means the agency or agencies of any local governing body or the State Fire Marshal charged with the administration or enforcement of the Fire Prevention Code.

"*Fire Prevention Code*" or "*Code*" means the Statewide Fire Prevention Code.

"*Fire prevention regulation*" means any law, rule, resolution, regulation, ordinance or code, general or special, or compilation thereof to safeguard life and property from the hazards of fire or explosion arising from the improper maintenance of life safety and fire prevention and protection materials, devices, systems and structures, and the unsafe storage, handling and use of substances, materials and devices, including explosives and blasting agents, wherever located, heretofore or hereafter enacted or adopted by the Commonwealth or any county or municipality, including departments, boards, bureaus, commissions or other agencies.

"*Fire Services Board*" means the Virginia Fire Services Board as provided for in § 9-153.1.

"*Inspection warrant*" means an order in writing, made in the name of the Commonwealth, signed by any judge or magistrate whose territorial jurisdiction encompasses the building, structure or premises to be inspected or entered, and directed to a state or local official, commanding him to enter and to conduct any inspection, examination, testing or collection of samples for testing required or authorized by the Virginia Statewide Fire Prevention Code.

"*Local government*" means the governing body of any

city, county or town in this Commonwealth.

"*State Fire Marshal*" means the State Fire Marshal as provided for by § 36-139.2.

§ 27-96. **Statewide standards.** The purposes of this chapter are to provide for statewide standards for optional local enforcement to safeguard life and property from the hazards of fire or explosion arising from the improper maintenance of life safety and fire prevention and protection materials, devices, systems and structures, and the unsafe storage, handling, and use of substances, materials and devices, including explosives and blasting agents, wherever located.

§ 27-97. **Adoption of Fire Prevention Code.** The Board of Housing and Community Development is hereby empowered to adopt and promulgate a Statewide Fire Prevention Code which shall be cooperatively developed with the Fire Services Board pursuant to procedures agreed to by the two Boards. The Fire Prevention Code shall prescribe regulations to be complied with for the protection of life and property from the hazards of fire or explosion and for the handling, storage and use of explosives or blasting agents, and shall provide for the administration and enforcement of such regulations. The Fire Prevention Code shall require manufacturers of explosives, as defined in the Code, to register and report information concerning their manufacturing facilities and methods of operation within this Commonwealth in accordance with regulations adopted by the Board. The Board shall also establish regulations for obtaining permits for the manufacturing, storage, handling, use, or sales of explosives. In the enforcement of such regulations, the enforcing agency may issue annual permits for such activities to any state regulated public utility. Such permits shall not apply to the storage, handling, or use of explosives or blasting agents pursuant to the provisions of Title 45.1.

The Fire Prevention Code shall supersede fire prevention regulations heretofore adopted by local governments or other political subdivisions. Local governments are hereby empowered to adopt fire prevention regulations that are more restrictive or more extensive in scope than the Fire Prevention Code provided such regulations do not affect the manner of construction, or materials to be used in the erection, alteration, repair, or use of a building or structure, including the voluntary installation of smoke alarms and regulation and inspections thereof in commercial buildings where such smoke alarms are not required under the provisions of the Code.

In formulating the Fire Prevention Code, the Board shall have due regard for generally accepted standards as recommended by nationally recognized organizations including, but not limited to, standards of the Southern Building Code Congress, the Building

Officials and Code Administrators International, Inc., the National Fire Protection Association, and recognized organizations issuing standards for the protection of the public from the hazards of explosives and blasting agents. Such standards shall be based on the companion document to the model building code referenced by the Uniform Statewide Building Code. The Fire Prevention Code shall require that buildings constructed prior to 1973 be maintained in accordance with state fire and public building regulations in effect prior to March 31, 1986. The Fire Prevention Code shall also require annual fire drills in all buildings having floors used for human occupancy located more than seventy-five feet above the lowest level of fire department vehicle access. The drills shall be conducted by building staff personnel or the owner of the building in accordance with a plan approved by the appropriate fire official and shall not affect other current occupants. The Board may modify, amend or repeal any Code provisions as the public interest requires. Any such Code changes shall be developed in cooperation with the Fire Services Board pursuant to procedures agreed to by the two Boards.

§ 27-97.1. Reports of stolen explosives. Any person holding a permit for the manufacture, storage, handling, use or sale of explosives issued in accordance with the provisions of the Code shall report to the office of the chief arson investigator for the Commonwealth as well as the chief local law-enforcement official any theft or other unauthorized taking or disappearance of any explosives or blasting devices from their inventory. An initial verbal report shall be made within three days of the discovery of the taking or disappearance. A subsequent written report shall be filed within such time, and in such form, as is specified by the chief arson investigator.

Failure to comply with the provisions of this section shall constitute a Class 1 misdemeanor punishable by the same penalties applicable to violations of the Fire Prevention Code.

§ 27-98. Enforcement of Fire Prevention Code; appeals from decisions of local enforcing agencies; inspection of buildings. Any local government may enforce the Fire Prevention Code. The State Fire Marshal shall also have the authority, in cooperation with any local governing body, to enforce the Code. The State Fire Marshal shall also have authority to enforce the Code in those jurisdictions in which the local governments do not enforce the Code. The local governing body may establish such procedures or requirements as may be necessary for the administration and enforcement of the Code. Appeals concerning the application of the Code by the local enforcing agency shall first lie to a local board of appeals and then to the State Building Code Technical

Review Board. Appeals from the application of the Code by the State Fire Marshal shall be made directly to the State Building Code Technical Review Board as provided in § 36-108 et seq. Fees may be levied by the local governing body in order to defray the cost of such enforcement and appeals.

§ 27-98.1. Inspections of buildings, structures, properties and premises. In order to carry out the purposes of the Code and any regulations or standards adopted in pursuance thereof, the local fire official, upon presenting appropriate credentials to the owner, operator, or agent in charge, is authorized, with the consent of the owner, operator, or agent in charge to enter a building, structure, property or premises for the purpose of conducting an inspection, examination, testing, or collection of samples for testing, during regular working hours and at other reasonable times, and in a reasonable manner, to determine if the building, structures, systems, machines, apparatus, devices, equipment, and materials stored, used or handled, and all pertinent conditions therein, are in compliance with the requirements, regulations or standards set forth in the Code.

§ 27-98.2. Issuance of warrant. Search warrants for inspections or reinspection of buildings, structures, property, or premises subject to inspections pursuant to the Code, to determine compliance with regulations or standards set forth in the Code, shall be based upon a demonstration of probable cause and supported by affidavit. Such inspection warrants may be issued by any judge or magistrate having authority to issue criminal warrants whose territorial jurisdiction encompasses the building, structure, property or premises to be inspected or entered, if he is satisfied from the affidavit that there is probable cause for the issuance of an inspection warrant. No inspection warrant shall be issued pursuant to this chapter except upon probable cause, supported by affidavit, particularly describing the place, thing or property to be inspected, examined or tested and the purpose for which the inspection, examination, testing or collection of samples for testing is to be made. Probable cause shall be deemed to exist if such inspection, examination, testing or collection of samples for testing are necessary to ensure compliance with the Fire Prevention Code for the protection of life and property from the hazards of fire or explosion. The supporting affidavit shall contain either a statement that consent to inspect, examine, test or collect samples for testing has been sought and refused or facts or circumstances reasonably justifying the failure to seek such consent in order to enforce effectively the fire safety laws, regulations or standards of the Commonwealth which authorize such inspection, examination, testing or collection of

APPENDIX A.

samples for testing. In the case of an inspection warrant based upon legislative or administrative standards for selecting buildings, structures, property or premises for inspections, the affidavit shall contain factual allegations sufficient to justify an independent determination by the judge or magistrate that the inspection program is based on reasonable standards and that the standards are being applied to a particular place in a neutral and fair manner. The issuing judge or magistrate may examine the affiant under oath or affirmation to verify the accuracy of any matter in the affidavit.

§ 27-98.3. Duration of warrant. An inspection warrant shall be effective for the time specified therein, for a period of not more than seven days, unless extended or renewed by the judicial officer who signed and issued the original warrant. The judicial officer may extend or renew the inspection warrant upon application for extension or renewal setting forth the results which have been obtained or a reasonable explanation of the failure to obtain such results. The extension or renewal period of the warrant shall not exceed seven days. The warrant shall be executed and returned to the judicial officer by whom it was issued within the time specified in the warrant or within the extended or renewed time. The return shall list any samples taken pursuant to the warrant. After the expiration of such time, the warrant, unless executed, shall be void.

§ 27-98.4. Conduct of inspections, examinations, testing, or collection of samples. No warrant shall be executed in the absence of the owner, operator or agent in charge of the particular building, structure, property or premises unless specifically authorized by the issuing judicial officer upon showing that such authority is reasonably necessary to effect the purposes of a statute or regulation being enforced. An entry pursuant to this warrant shall not be made forcibly, except that the issuing officer may expressly authorize a forcible entry (i) where facts are shown sufficient to create a reasonable suspicion of an immediate threat to an occupant of the particular building, structure, property, or premises, or, to the general safety and welfare of the public, or, to adjacent buildings, structures, properties or premises, or (ii) where facts are shown establishing that reasonable attempts to serve a previous warrant have been unsuccessful. If forcible entry is authorized, the warrant shall be issued jointly to the fire official and to a law-enforcement officer who shall accompany the fire official during the execution.

§ 27-98.5. Review by courts. A. No court of the Commonwealth shall have jurisdiction to hear a challenge to the warrant prior to its return to the issuing judge or magistrate except as a defense in a

contempt proceeding, unless the owner or custodian of the building, structure, property or premises to be inspected makes by affidavit a substantial preliminary showing accompanied by an offer of proof that (i) a false statement, knowingly and intentionally, or with reckless disregard for the truth, was included by the affiant in his affidavit for the inspection warrant and (ii) the false statement was necessary to the finding of probable cause. The court shall conduct such expeditious in camera view as the court may deem appropriate.

B. After the warrant has been executed and returned to the issuing judge, the validity of the warrant may be reviewed either as a defense to any citation issued by the fire official or otherwise by declaratory judgment action brought in a circuit court. In any such action, the review shall be confined to the face of the warrant and affidavits and supporting materials presented to the issuing judge unless the owner, operator, or agent in charge of whose building, structure, property or premises has been inspected makes a substantial showing by affidavit accompanied by an offer of proof that (i) a false statement, knowingly and intentionally, or with reckless disregard for the truth, was made in support of the warrant and (ii) the false statement was necessary to the finding of probable cause. The review shall only determine whether there is substantial evidence in the record supporting the decision to issue the warrant.

§ 27-99. State buildings. The Fire Prevention Code shall be applicable to all state-owned buildings and structures. Every agency, commission or institution of the Commonwealth shall permit, at all reasonable hours, a local fire official reasonable access to existing structures or a structure under construction or renovation, for the purposes of performing an informational and advisory fire safety inspection. The local fire official may submit, subsequent to performing such inspection, his findings and recommendations including a list of corrective actions necessary to ensure that such structure is reasonably safe from the hazards of fire to the appropriate official of such agency, commission, or institution and the State Fire Marshal. Such agency, commission or institution shall notify, within sixty days of receipt of such findings and recommendations, the State Fire Marshal and the local fire official of the corrective measures taken to eliminate the hazards reported by the local fire official. The State Fire Marshal shall have the same power in the enforcement of this section as is provided for in § 27-98.

The State Fire Marshal may enter into an agreement as is provided for in § 36-139.4 with any local enforcement agency that enforces the Fire Prevention Code to enforce this section and to take

immediate enforcement action upon verification of a complaint of an imminent hazard such as a chained or blocked exit door, improper storage of flammable liquids, use of decorative materials and overcrowding. § 27-100. Violation a misdemeanor. It shall be unlawful for any owner or any other person, firm, or corporation, on or after the effective date of any Code provisions, to violate any provisions of the Fire Prevention Code. Any such violation shall be deemed a Class 1 misdemeanor, and any owner, or any other person, firm, or corporation convicted of such violation shall be punished in accordance with the provisions of § 18.2-11.

§ 27-101. Injunction upon application. Every court having jurisdiction under existing or any future law is empowered to and shall, upon the application of the local enforcing agency or State Fire Marshal, issue either a mandatory or restraining injunction in aid of the enforcement of, or in prevention of the violation of, any of the provisions of this law or any valid rule or regulation made in pursuance thereof. The procedure for obtaining any such injunction shall be in accordance with the laws then current governing injunctions generally except that the enforcing agency shall not be required to give bond as a condition precedent to obtaining an injunction.

§ 36-97. Definitions. As used in this chapter, unless the context or subject matter requires otherwise, the following words or terms shall have the meaning herein ascribed to them, respectively:

"Board" means the Board of Housing and Community Development.

"Review Board" means the State Building Code Technical Review Board.

"Building Code" means the Uniform Statewide Building Code and building regulations adopted and promulgated pursuant thereto.

"Code provisions" means the provisions of the Uniform Statewide Building Code as adopted and promulgated by the Board, and the amendments thereof as adopted and promulgated by such Board from time to time.

"Building regulations" means any law, rule, resolution, regulation, ordinance or code, general or special, or compilation thereof, heretofore or hereafter enacted or adopted by the Commonwealth or any county or municipality, including departments, boards, bureaus, commissions, or other agencies thereof, relating to construction, reconstruction, alteration, conversion, repair, maintenance, or use of structures and buildings and installation of equipment therein. The term does not include zoning ordinances or other land use controls that do not affect the manner of construction or materials to be used in the erection, alteration or repair of a building or structure.

"Municipality" means any city or town in this Commonwealth.

"Local governing body" means the governing body of any city, county or town in this Commonwealth.

"Local building department" means the agency or agencies of any local governing body charged with the administration, supervision, or enforcement of the Building Code and regulations, approval of plans, inspection of buildings, or issuance of permits, licenses, certificates or similar documents.

"State agency" means any state department, board, bureau, commission, or agency of this Commonwealth.

"Building" means a combination of any materials, whether portable or fixed, having a roof to form a structure for the use or occupancy by persons, or property; however, farm buildings not used for residential purposes and frequented generally by the owner, members of his family, and farm employees shall be exempt from the provisions of the Uniform Statewide Building Code, but such buildings lying within a flood plain or in a mudslide-prone area shall be subject to flood proofing regulations or mudslide regulations, as applicable. The word "building" shall be construed as though followed by the words "or part or parts thereof" unless the context clearly requires a different meaning.

"Equipment" means plumbing, heating, electrical, ventilating, air-conditioning and refrigeration equipment, elevators, dumbwaiters, escalators, and other mechanical additions or installations.

"Construction" means the construction, reconstruction, alteration, repair or conversion of buildings and structures.

"Owner" means the owner or owners of the freehold of the premises or lesser estate therein, a mortgagee or vendee in possession, assignee of rents, receiver, executor, trustee, or lessee in control of a building or structure.

"Director" means the Director of the Department of Housing and Community Development.

"Structure" means an assembly of materials forming a construction for occupancy or use including stadiums, gospel and circus tents, reviewing stands, platforms, stagings, observation towers, radio towers, water tanks, storage tanks (underground and aboveground), trestles, piers, wharves, swimming pools, amusement devices, storage bins, and other structures of this general nature but excluding water wells. Farm structures not used for residential purposes shall be exempt from the provisions of the Uniform Statewide Building Code, but such structures lying within a flood plain or in a mudslide-prone area shall be subject to flood proofing regulations or mudslide regulations, as applicable. The word

APPENDIX A.

"structure" shall be construed as though followed by the words "or part or parts thereof" unless the context clearly requires a different meaning.

"Department" means the Department of Housing and Community Development.

§ 36-98. Board to promulgate Statewide Code; other codes and regulations superseded; exceptions.

The Board is hereby directed and empowered to adopt and promulgate a Uniform Statewide Building Code. Such building code shall supersede the building codes and regulations of the counties, municipalities and other political subdivisions and state agencies. However, such Code shall not supersede the regulations of other state agencies which require and govern the functional design and operation of building related activities not covered by the Uniform Statewide Building Code including but not limited to: (1) public water supply systems, (2) waste water treatment and disposal systems, and (3) solid waste facilities. Nor shall state agencies be prevented from requiring, pursuant to other state law, that buildings and equipment be maintained in accordance with provisions of the Uniform Statewide Building Code.

§ 36-98.01. Mechanics' lien agent included on building permit for residential property at request of applicant.

In addition to any information required by the Uniform Statewide Building Code, a building permit issued for any one- or two-family residential dwelling unit shall at the time of issuance contain, at the request of the applicant, the name, mailing address, and telephone number of the mechanics' lien agent as defined in § 43-1. If the designation of a mechanics' lien agent is not so requested by the applicant, the building permit shall at the time of issuance state that none has been designated with the words "None Designated."

§ 36-98.1. State buildings. The Building Code shall be applicable to all state-owned buildings and structures, with the exception that §§ 2.1-514 through 2.1-521.1 shall provide the standards for ready access to and use of state-owned buildings by the physically handicapped.

Any state-owned building or structure for which preliminary plans were prepared or on which construction commenced after the initial effective date of the Uniform Statewide Building Code, shall remain subject to the provisions of the Uniform Statewide Building Code that were in effect at the time such plans were completed or such construction commenced. Subsequent reconstruction, renovation or demolition of such building or structure shall be subject to the pertinent provisions of the Building Code.

Acting through the Division of Engineering and Buildings, the Department of General Services shall

function as the building official for state-owned buildings. The Department shall review and approve plans and specifications, grant modifications, and establish such rules and regulations as may be necessary to implement this section. It shall provide for the inspection of state-owned buildings and enforcement of the Building Code and standards for access by the physically handicapped by delegating inspection and Building Code enforcement duties to the State Fire Marshal's Office, to other appropriate state agencies having needed expertise, and to local building departments, all of which shall provide such assistance within a reasonable time and in the manner requested. State agencies and institutions occupying buildings shall pay to the local building department the same fees as would be paid by a private citizen for the services rendered when such services are requested by the Department of General Services. The Department of General Services may alter or overrule any decision of the local building department after having first considered the local building department's report or other rationale given for its decision. When altering or overruling any decision of a local building department, the Department of General Services shall provide the local building department with a written summary of its reasons for doing so.

§ 36-98.2. Appeals from decision of Building Official regarding state-owned buildings. Appeals by the involved state agency from the decision of the Building Official for state-owned buildings shall be made directly to the State Building Code Technical Review Board.

§ 36-98.3. Amusement devices. A. The Board shall have the power and duty to promulgate regulations pertaining to the construction, maintenance, operation and inspection of amusement devices. Amusement device means (i) a device or structure open to the public by which persons are conveyed or moved in an unusual manner for diversion and (ii) passenger tramways. A "passenger tramway" means a device used to transport passengers uphill, and suspended in the air by the use of steel cables, chains or belts, or by ropes, and usually supported by trestles or towers with one or more spans. Regulations promulgated hereunder shall include provisions for the following:

1. The issuance of certificates of inspection prior to the operation of an amusement device;
2. The demonstration of financial responsibility of the owner or operator of the amusement device prior to the operation of an amusement device;
3. Maintenance inspections of existing amusement devices;
4. Reporting of accidents resulting in serious injury or death;

5. Immediate investigative inspections following accidents involving an amusement device that result in serious injury or death;

6. Certification of amusement device inspectors;

7. Qualifications of amusement device operators;

8. Notification by amusement device owners or operators of an intent to operate at a location within the Commonwealth; and

9. A timely reconsideration of the decision of the local building department when an amusement device owner or operator is aggrieved by such a decision.

B. In promulgating regulations, the Board shall have due regard for generally accepted standards as recommended by nationally recognized organizations. Where appropriate, the Board shall establish separate standards for mobile amusement devices and for amusement devices permanently affixed to a site.

C. To assist the Board in the administration of this section, the Board shall appoint an Amusement Device Technical Advisory Committee, which shall be composed of five members who, by virtue of their education, training or employment, have demonstrated adequate knowledge of amusement devices or the amusement industry. The Board shall determine the terms of the Amusement Device Technical Advisory Committee members. The Amusement Device Technical Advisory Committee shall recommend standards for the construction, maintenance, operation and inspection of amusement devices, including the qualifications of amusement device operators and the certification of inspectors, and otherwise perform advisory functions as the Board may require.

D. Inspections required by this section shall be performed by persons certified by the Board pursuant to subdivision 7 of § 36-137 as competent to inspect amusement devices. The provisions of § 36-105 notwithstanding, the local governing body shall enforce the regulations promulgated by the Board for existing amusement devices. Nothing in this section shall be construed to prohibit the local governing body from authorizing inspections to be performed by persons who are not employees of the local governing body, provided those inspectors are certified by the Board as provided herein. The Board is authorized to conduct or cause to be conducted any inspection required by this section, provided that the person performing the inspection on behalf of the Board is certified by the Board as provided herein.

E. To the extent they are not superseded by the provisions of this section and the regulations promulgated hereunder, the provisions of this chapter and the Uniform Statewide Building Code shall apply to amusement devices.

§ 36-99. Provisions of Code. The Building Code shall prescribe building regulations to be complied

with in the construction of buildings and structures, and the equipment therein as defined in § 36-97, and shall prescribe regulations to insure that such regulations are properly maintained, and shall also prescribe procedures for the administration and enforcement of such regulations. The provisions thereof shall be such as to protect the health, safety and welfare of the residents of this Commonwealth, provided that buildings and structures should be permitted to be constructed at the least possible cost consistent with recognized standards of health, safety, energy conservation and water conservation and barrier-free provisions for the physically handicapped and aged. Such regulations shall be reasonable and appropriate to the objectives of this chapter.

In formulating the Code provisions, the Board shall have due regard for generally accepted standards as recommended by nationally recognized organizations, including, but not limited to, the standards of the Southern Building Code Congress, the Building Officials Conference of America and the National Fire Protection Association.

Where practical, the Code provisions shall be stated in terms of required level of performance, so as to facilitate the prompt acceptance of new building materials and methods. When generally recognized standards of performance are not available, such provisions shall provide for acceptance of materials and methods whose performance has been found by the Board, on the basis of reliable test and evaluation data, presented by the proponent, to be substantially equal in safety to those specified.

§ 36-99.2. Standards for replacement glass. Any replacement glass installed in buildings constructed prior to the effective date of the Uniform Statewide Building Code shall meet the quality and installation standards for glass installed in new buildings as are in effect at the time of installation.

§ 36-99.3. Smoke detectors in colleges and universities. College or university buildings containing dormitories for sleeping purposes shall be provided with battery or AC powered smoke detector devices installed therein in accordance with the Uniform Statewide Building Code. After January 1, 1984, all college and university dormitories shall have installed and use due diligence in maintaining in good working order such detectors regardless of when the building was constructed.

The chief administrative office of the college or university shall obtain a certificate of compliance from the building official of the locality in which the college or university is located or in the case of state-owned buildings, from the Director of the Department of General Services.

The provisions of this section shall not apply to any

APPENDIX A.

dormitory at a state-supported military college or university which is patrolled twenty-four hours a day by military guards.

§ 36-99.4. Smoke detectors in certain juvenile care facilities. Battery or AC-powered smoke detector devices shall be installed in all local and regional detention homes, group homes, and other residential care facilities for children or juveniles which are operated by or under the auspices of the Department of Youth and Family Services, regardless of when the building was constructed, in accordance with the provision of the Uniform Statewide Building Code by July 1, 1986. Administrators of such homes and facilities shall be responsible for the installation and maintenance of the smoke detector devices.

§ 36-99.5. Smoke detectors for the deaf and hearing-impaired. Smoke detectors providing an effective intensity of not less than 100 candela to warn a deaf or hearing-impaired individual shall be provided, upon request by the occupant to the landlord or proprietor, to any deaf or hearing-impaired occupant of any of the following occupancies, regardless of when constructed:

1. All dormitory buildings arranged for the shelter and sleeping accommodations of more than twenty individuals;

2. All multiple-family dwellings having more than two dwelling units, including all dormitories, boarding and lodging houses arranged for shelter and sleeping accommodations of more than five individuals; or

3. All buildings arranged for use of one-family or two-family dwelling units.

A tenant shall be responsible for the maintenance and operation of the smoke detector in the tenant's unit.

A hotel or motel shall have available no fewer than one such smoke detector for each seventy units or portion thereof, except that this requirement shall not apply to any hotel or motel with fewer than thirty-five units. The proprietor of the hotel or motel shall post in a conspicuous place at the registration desk or counter a permanent sign stating the availability of smoke detectors for the hearing-impaired. Visual detectors shall be provided for all meeting rooms for which an advance request has been made.

The proprietor or landlord may require a refundable deposit for a smoke detector, not to exceed the original cost or replacement cost, whichever is greater, of the smoke detector. Rental fees shall not be increased as compensation for this requirement.

Landlords shall notify hearing-impaired tenants of the availability of special smoke detectors; however, no landlord shall be civilly or criminally liable for failure to so notify. New tenants shall be asked, in writing, at the time of rental, whether visual smoke

detectors will be needed.

Failure to comply with the provisions of this section within a reasonable time shall be punishable as a Class 3 misdemeanor.

This law shall have no effect upon existing local law or regulation which exceeds the provisions prescribed herein.

§ 36-99.5:1. Smoke detectors in adult care residences, adult day care centers and nursing homes and facilities. A. Battery- or AC-powered smoke detector devices shall be installed in all adult care residences and adult day care centers licensed by the Department of Social Services, regardless of when the building was constructed. The location and installation of the smoke detectors shall be determined by the Uniform Statewide Building Code.

The licensee shall obtain a certificate of compliance from the building official of the locality in which the residence or center is located, or in the case of state-owned buildings, from the Department of General Services.

The licensee shall maintain the smoke detector devices in good working order.

B. The Board of Housing and Community Development shall promulgate regulations in accordance with the Administrative Process Act (§ 9-6.14:1 et seq.) establishing standards for requiring smoke detectors in nursing homes and nursing facilities. All nursing homes and nursing facilities which are already equipped with sprinkler systems shall comply with these regulations.

§ 36-99.6. Underground and aboveground storage tank inspections. A. The Board of Housing and Community Development shall incorporate, as part of the Building Code, regulations adopted and promulgated by the State Water Control Board governing the installation, repair, upgrade and closure of underground and aboveground storage tanks.

B. Inspections undertaken pursuant to such Building Code regulations shall be done by employees of the local building department or another individual authorized by the local building department.

§ 36-99.7. Asbestos inspection in buildings to be renovated or demolished; exceptions. A. A local building department shall not issue a building permit allowing a building to be renovated or demolished until the local building department receives certification from the owner or his agent that the affected portions of the building have been inspected for the presence of asbestos by an individual licensed to perform such inspections pursuant to § 54.1-503 and that no asbestos-containing materials were found or that appropriate response actions will be undertaken in accordance with the requirements of the Clean Air Act National Emission Standard for the Hazardous Air

Pollutant (NESHAPS) (40 CFR 61, Subpart M), and the asbestos worker protection requirements established by the U.S. Occupational Safety and Health Administration for construction workers (29 CFR 1926.58). Local educational agencies that are subject to the requirements established by the Environmental Protection Agency under the Asbestos Hazard Emergency Response Act (AHERA) shall also certify compliance with 40 CFR 763 and subsequent amendments thereto.

B. To meet the inspection requirements of subsection A except with respect to schools, asbestos inspection of renovation projects consisting only of repair or replacement of roofing, floorcovering, or siding materials may be satisfied by:

1. A statement that the materials to be repaired or replaced are assumed to contain asbestos and that asbestos installation, removal, or encapsulation will be accomplished by a licensed asbestos contractor or a licensed RFS contractor; or

2. A certification by the owner that sampling of the material to be renovated was accomplished by an RFS inspector as defined in § 54.1-500 and analysis of the sample showed no asbestos to be present.

C. The provisions of this section shall not apply to single-family dwellings or residential housing with four or fewer units, unless the renovation or demolition of such buildings is for commercial or public development purposes. The provisions of this section shall not apply if the combined amount of regulated asbestos-containing material involved in the renovation or demolition is less than 260 linear feet on pipes or less than 160 square feet on other facility components or less than thirty-five cubic feet off facility components where the length or area could not be measured previously.

D. An abatement area shall not be reoccupied until the building official receives certification from the owner that the response actions have been completed and final clearances have been measured. The final clearance levels for reoccupancy of the abatement area shall be 0.01 or fewer asbestos fibers per cubic centimeter if determined by Phase Contrast Microscopy analysis (PCM) or 70 or fewer structures per square millimeter if determined by Transmission Electron Microscopy analysis (TEM).

§ 36-99.8. Skirting. Manufactured homes installed or relocated pursuant to the Building Code shall have skirting installed within sixty days of occupancy of the home. Skirting materials shall be durable, suitable for exterior exposures, and installed in accordance with the manufacturer's installation instructions. Skirting shall be secured as necessary to ensure stability, to minimize vibrations, to minimize susceptibility to wind damage, and to compensate for possible frost

heave. Each manufactured home shall have a minimum of one opening in the skirting providing access to any water supply or sewer drain connections under the home. Such openings shall be a minimum of eighteen inches in any dimension and not less than three square feet in area. The access panel or door shall not be fastened in a manner requiring the use of a special tool to open or remove the panel or door. On-site fabrication of the skirting by the owner or installer of the home shall be acceptable, provided that the material meets the requirements of the Building Code.

As used in this section, "skirting" means a weather-resistant material used to enclose the space from the bottom of the manufactured home to grade.

§ 36-99.9. Standards for fire suppression systems in certain facilities. The Board of Housing and Community Development shall promulgate regulations by October 1, 1990, in accordance with the Administrative Process Act, Chapter 1.1:1 (§ 9-6.14:1 et seq.) of Title 9, establishing standards for fire suppression systems in nursing facilities and nursing homes, regardless of when such facilities or institutions were constructed. In the development of these standards, the Board shall seek input from relevant state agencies.

Units consisting of certified long-term care beds described in this section and § 32.1-126.2 located on the ground floor of general hospitals shall be exempt from the requirements of this section.

§ 36-99.10:1. Standards for installation of acoustical treatment measures in certain buildings and structures. The Board of Housing and Community Development shall promulgate regulations by October 1, 1994, for installation of acoustical treatment measures for construction in areas affected by above average noise levels from aircraft due to their proximity to flight operations at nearby airports. Such regulations shall provide for implementation at the option of a local governing body pursuant to the provisions of § 15.1-491.03.

§ 36-99.11. Identification of handicapped parking spaces by above grade signage. A. All parking spaces reserved for the use of handicapped persons shall be identified by above grade signs, regardless of whether identification of such spaces by above grade signs was required when any particular space was reserved for the use of handicapped persons. A sign or symbol painted or otherwise displayed on the pavement of a parking space shall not constitute an above grade sign. Any parking space not identified by an above grade sign shall not be a parking space reserved for the handicapped within the meaning of this section.

B. All above grade handicapped parking space

APPENDIX A.

signs shall have the bottom edge of the sign no lower than four feet nor higher than seven feet above the parking surface. Such signs shall be designed and constructed in accordance with the provisions of the Uniform Statewide Building Code.

C. Building owners shall install above grade signs identifying all parking spaces reserved for the use of handicapped persons in accordance with this section and the applicable provisions of the Uniform Statewide Building Code by January 1, 1993.

§ 36-100. Notice and hearings on adoption of Code, amendments and repeals. The Board shall adopt, amend, or repeal any Code provisions in accordance with the Administrative Process Act, Chapter 1.1:1 (§ 9-6.14:1 et seq.) of Title 9. Before any such action, the Board shall hold at least one public hearing. In addition to the notice requirement contained therein, the Board shall notify in writing the building official or, where none, the local governing body of every city or county in the Commonwealth. At any such hearing all persons desiring to do so shall be afforded an opportunity to present their views.

§ 36-101. Effective date of Code; when local codes may remain in effect. No Code provisions shall be made effective prior to January 1, 1973, or later than September 1, 1973; provided that the initial Building Code shall not become effective earlier than 180 days after the publication thereof.

It is further provided that where, in the opinion of the Review Board, local codes are in substantial conformity with the State Code the local code may, with the concurrence of the Review Board remain in effect for two years from the effective day of the State Code for transition to implementation of the State Code.

§ 36-102. Modification, amendment or repeal of Code provisions. The Board may modify, amend or repeal any Code provisions from time to time as the public interest requires, after notice and hearing as provided in § 36-100 of this chapter. No such modification or amendment shall be made effective earlier than thirty days from the adoption thereof.

§ 36-103. Buildings, etc., existing or projected before effective date of Code. Any building or structure, for which a building permit has been issued or on which construction has commenced, or for which working drawings have been prepared in the year prior to the effective date of the Building Code, shall remain subject to the building regulations in effect at the time of such issuance or commencement of construction. However, the Board may adopt and promulgate as part of the Building Code, minimum building regulations for existing buildings to ensure the protection of public health, safety and welfare. Subsequent reconstruction, renovation, repair or

demolition of such buildings or structures shall be subject to the pertinent provisions of the Building Code. The provisions of this section shall be applicable to equipment. However, building owners may elect to install partial or full fire alarms or other safety equipment that was not required by the Building Code in effect at the time a building was constructed without meeting current Building Code requirements, provided the installation does not create a hazardous condition. Permits for installation shall be obtained in accordance with the Uniform Statewide Building Code.

§ 36-104. Code to be printed and furnished on request; true copy. The Department shall have printed from time to time and keep available in pamphlet form all Code provisions. Such pamphlets shall be furnished upon request to members of the public. A true copy of all such provisions adopted and in force shall be kept in the office of the Department, accessible to the public. The Department may charge a reasonable fee for distribution of the Building Code based on production and distribution costs.

§ 36-105. Enforcement of Code; appeals from decisions of local department; inspection of buildings. Enforcement of the Building Code shall be the responsibility of the local building department. There shall be established within each local building department a local board of Building Code appeals whose composition, duties and responsibilities shall be prescribed in the Building Code. Appeals from the local building department concerning application of the Building Code or refusal to grant a modification to the provisions of the Building Code covering the manner of construction or materials to be used in the erection, alteration or repair of a building or structure shall first lie to the local board of Building Code appeals. No appeal to the State Building Code Technical Review Board shall lie prior to a final determination by the local board of Building Code appeals. Whenever a county or a municipality does not have such a building department or board of Building Code appeals, the local governing body shall enter into an agreement with the local governing body of another county or municipality or with some other agency, or a state agency approved by the Department for such enforcement and appeals resulting therefrom. For the purposes of this section, towns with a population of less than 3,500 may elect to administer and enforce the Building Code; however, where the town does not elect to administer and enforce the Building Code, the county in which the town is situated shall administer and enforce the Building Code for the town. In the event such town is situated in two or more counties, those counties shall administer and enforce the Building Code for that portion of the town which is

situated within their respective boundaries. Fees may be levied by the local governing body in order to defray the cost of such enforcement and appeals.

Any building or structure may be inspected at any time before completion, and shall not be deemed in compliance until approved by the inspecting authority. Where the construction cost is less than \$2,500, however, the inspection may, in the discretion of the inspecting authority, be waived. The building official shall coordinate all reports of inspections for compliance with the Building Code, with inspections of fire and health officials delegated such authority, prior to issuance of an occupancy permit.

The local governing body may also inspect and enforce the Building Code for existing buildings and structures, whether occupied or not, including such regulations for elevators. Such inspection and enforcement shall be carried out by an agency or department designated by the local governing body. However, upon a finding by the local building department, following a complaint by a tenant of a residential rental unit which is the subject of such complaint, that there may be a violation of § 105 of Volume II of the Building Code, the local building department shall enforce § 105 of Volume II.

The local governing body may, upon an affirmative finding of the need to protect the public health, safety and welfare, require the issuance of certificates of compliance with current building regulations for existing residential buildings located in conservation and rehabilitation districts designated by the local governing body after inspections of such buildings upon termination of the rental tenancies or when such rental property is sold. Such certificate of compliance shall be issued in accordance with the administrative provisions of the Uniform Statewide Building Code.

§ 36-105.01. Elevator inspections.

If the local building department elects to inspect and enforce building regulations for elevators in existing buildings, then such inspection and enforcement shall be in compliance with the regulations adopted by the Board. The building department may also provide for such inspection by an approved agency or through agreement with other local certified elevator inspectors. An approved agency includes any individual, partnership or corporation who has met the certification requirements established by the Board. The Board shall establish such qualifications and procedures as it deems necessary to certify an approved agency. Such qualifications and procedures shall be based upon nationally accepted standards.

§ 36-105.1. Inspection and review of plans of buildings under construction. Inspections of buildings other than state-owned buildings under construction and the review and approval of building

plans for these structures for enforcement of the Uniform Statewide Building Code shall be the sole responsibility of the appropriate local building inspectors. Upon completion of such structures, responsibility for fire safety protection shall pass to the State Fire Marshal pursuant to the Statewide Fire Prevention Code in those localities which do not enforce the Statewide Fire Prevention Code (§ 27-94 et seq.).

§ 36-106. Violation a misdemeanor; civil penalty.

A. It shall be unlawful for any owner or any other person, firm or corporation, on or after the effective date of any Code provisions, to violate any such provisions. Any such violation shall be deemed a misdemeanor and any owner or any other person, firm or corporation convicted of such a violation shall be punished by a fine of not more than \$2,500. If the violation concerns a residential unit and if the violation remains uncorrected at the time of the conviction, the court shall order the violator to abate or remedy the violation in order to comply with the Code. Except as otherwise provided by the court for good cause shown, any such violator shall abate or remedy the violation within six months of the date of conviction. Any person convicted of a second offense committed within less than five years after a first offense under this chapter shall be punished by a fine of not less than \$1,000 nor more than \$2,500. Any person convicted of a second offense committed within a period of five to ten years of a first offense under this chapter shall be punished by a fine of not less than \$500 nor more than \$2,500. Any person convicted of a third or subsequent offense committed within ten years of an offense under this chapter shall be punished by a fine of not less than \$1,500 nor more than \$2,500. Notwithstanding the foregoing, those provisions requiring a minimum fine shall apply only to convictions for building code violations which cause a building or structure to be unsafe or unfit for human habitation.

B. If a locality has adopted an ordinance establishing a uniform schedule of civil penalties as permitted by § 15.1-499.1, any person who violates any provision of the Building Code and who fails to abate or remedy the violation promptly after receipt of notice of violation from the local enforcement officer, shall, upon a finding of an appropriate general district court, be assessed a civil penalty in accordance with the schedule. A civil action for such violation may be brought by the locality wherein the land upon which the structure is located lies. In any trial for a scheduled violation, it shall be the burden of the locality to show the liability of the violator by a preponderance of the evidence. An admission of liability or finding of liability shall not be a criminal

APPENDIX A.

conviction for any purpose. If the violation concerns a residential unit, and if the violation remains uncorrected at the time of assessment of the civil penalty, the court shall order the violator to abate or remedy the violation in order to comply with the Code. Except as otherwise provided by the court for good cause shown, any such violator shall abate or remedy the violation within six months of the date of the assessment of the civil penalty.

C. Any owner or any other person, firm or corporation violating any Code provisions relating to the removal or the covering of lead-base paint which poses a hazard to the health of pregnant women and children under the age of six years who occupy the premises shall, upon conviction, be guilty of a misdemeanor and shall be subject to a fine of not more than \$2,500. If the court convicts pursuant to this subsection and sets a time by which such hazard must be abated, each day the hazard remains unabated after the time set for the abatement has expired shall constitute a separate violation of the Uniform Statewide Building Code. Upon a reasonable showing to the court by a landlord as defined in § 55-248.4, that such landlord is financially unable to abate the lead-base paint hazard, the court shall order any rental agreement related to the affected premises terminated effective thirty days from the entry of the court order. For the purposes of the preceding sentence, termination of the rental agreement shall not be deemed noncompliance by the landlord pursuant to § 55-248.21.

D. Any prosecution under this section shall be commenced within two years as provided in § 19.2-8.

§ 36-107. Employment of personnel for administration of chapter. Subject to the provisions of Chapter 10 (§ 2.1-110 et seq.) of Title 2.1, the Director may employ such permanent and temporary clerical, technical and other assistants as are necessary or advisable for the proper administration of the provision of this chapter.

§ 36-107.1. Sale of residential structure with lead-based paint levels exceeding Code standards; penalty. Whenever any property owner has been notified by local building officials or representatives of local health departments that any residential premise has levels of lead-based paint in violation of this chapter, such property owner shall notify prospective purchasers in writing of the presence of unacceptable levels of lead-based paint in such premises and the requirements concerning the removal of the same. Such notification shall include a copy of any notice the property owner received from local building officials or representatives of local health departments advising of the presence of unacceptable levels of lead-based paint in such premises.

The notice required herein shall be provided to prospective purchasers prior to the signing of a purchase or sales agreement or, if there is no purchase or sales agreement, prior to the signing of a deed. The requirements shall not apply to purchase and sales agreements or deeds signed prior to July 1, 1991. Transactions in which sellers have accepted written offers prior to July 1, 1991, but have not signed a purchase or sales agreement or a deed prior to July 1, 1991, shall be subject to the notice requirements.

Any person who fails to comply with the provisions of this section shall be liable for all damages caused by his failure to comply and shall, in addition, be liable for a civil penalty not to exceed \$1,000.

§ 36-108. Board continued; members.

There is hereby continued, in the Department, the State Building Code Technical Review Board, consisting of twelve members, appointed by the Governor subject to confirmation by the General Assembly. The members shall include one member who is a registered architect, selected from a slate presented by the Virginia Society of the American Institute of Architects; one member who is a professional engineer in private practice, selected from a slate presented by the Virginia Society of Professional Engineers; one member who is a residential builder selected from a slate presented by the Home Builders Association of Virginia; one member who is a general contractor selected from a slate presented by the Virginia Branch, Associated General Contractors of America; two members who have had experience in the field of enforcement of building regulations, selected from a slate presented by the Virginia Building Officials Conference; one member who is employed by a public agency as a fire prevention officer selected from a slate presented by the State Fire Chiefs Association of Virginia; one member whose primary occupation is commercial or retail construction or operation and maintenance selected from a slate presented by the Virginia chapters of Building Owners and Managers Association, International; one member whose primary occupation is residential, multifamily housing construction or operation and maintenance selected from a slate presented by the Virginia chapters of the National Apartment Association; one member who is an electrical contractor who has held a Class A license for at least ten years; and two members from the Commonwealth at large who may be members of local governing bodies. The members shall serve at the pleasure of the Governor.

§ 36-109. Officers; secretary. The Review Board, under rules adopted by itself, shall elect one of its members as chairman, for a term of two years, and may elect one of its members as vice-chairman. The

Review Board may also elect a secretary, who may be a nonmember.

§ 36-111. Oath and bonds. Before entering upon the discharge of his duties, each member of the Review Board shall take an oath that he will faithfully and honestly execute the duties of his office during his continuance therein; and shall give bond with corporate surety in such penalty as may be fixed by the Governor, conditioned upon the faithful discharge of his duties. The premiums on such bonds shall be paid for as other expenses of the Department are paid.

§ 36-112. Meetings. The Review Board shall meet at the call of the chairman, or at the written request of at least three of its members; provided that it shall act within thirty days following receipt of any appeal made under the provisions of this chapter.

§ 36-113. Offices. The Review Board shall be furnished adequate space and quarters in the suite of offices of the Department, and such Board's main office shall be therein.

§ 36-114. Board to hear appeals. The Review Board shall have the power and duty to hear all appeals from decisions arising under application of the Building Code, the Fire Prevention Code adopted under the Statewide Fire Prevention Code Act (§ 27-94 et seq.), the Industrialized Building Safety Law (§ 36-70 et seq.), the Virginia Manufactured Housing Construction and Safety Standards Law (§ 36-85.2 et seq.), and the Virginia Certification Standards adopted by the Board of Housing and Community Development, and to render its decision on any such appeal, which decision shall be final if no appeal is made therefrom. Proceedings of the Review Board shall be governed by the provisions of the Administrative Process Act (§ 9-6.14:1 et seq.).

§ 36-115. Subpoenas; witnesses; designation of subordinates. In any matter before it on appeal for hearing and determination, the Review Board, or its designated subordinates, may compel the attendance of all needed witnesses in like manner as a circuit court, save the Review Board shall not have the power of imprisonment. In taking evidence, the chairman or any member of the Review Board, or its designated subordinates, shall have the power to administer oaths to witnesses. Where a designated subordinate or the Review Board presides over hearings on appeals, such subordinate shall submit recommended findings and a decision to the Review Board pursuant to § 9-6.14:12.

§ 36-117. Record of decisions. A record of all decisions of the Review Board, properly indexed, shall be kept in the office of such Board. Such record shall be open to public inspection at all times during business hours.

§ 36-118. Interpretation of Code; recommendation

of modifications. The Review Board shall interpret the provisions of the Building Code, and the Fire Prevention Code, and shall make such recommendations, which it deems appropriate, to the Board for modification, amendment or repeal of any of such provisions. A record of all such recommendations, and of the Board's actions thereon, shall be kept in the office of the Review Board. Such record shall be open to public inspection at all times during business hours.

§ 36-119. Rules and regulations under § 36-73 not superseded. This chapter shall not amend, supersede, or repeal the rules and regulations prescribing standards to be complied with, in industrialized building units and mobile homes promulgated under § 36-73.

§ 36-119.1. Existing buildings. This chapter shall not supersede provisions of the Fire Prevention Code promulgated by the Board under § 27-97, that prescribe standards to be complied with in existing buildings or structures, provided that such regulations shall not impose requirements that are more restrictive than those of the Uniform Statewide Building Code under which the buildings or structures were constructed. Subsequent alteration, enlargement, repair, or conversion of the occupancy classification of such buildings and structures shall be subject to the Building Code.

§ 36-131. Definitions. As used in this chapter, the following words and terms have the following meanings, unless a different meaning clearly appears from the context:

"Department" means the Department of Housing and Community Development.

"Director" means the Director of the Department of Housing and Community Development.

"Board" means the Board of Housing and Community Development.

"Comprehensive Housing Affordability Strategy" means a document setting forth various housing goals, objectives, and strategies to be followed by the Commonwealth in addressing housing conditions in the Commonwealth and serving as the strategic plan for the programs established by the Department and, to the extent and in the manner determined in accordance with § 36-55.27:1, for the programs established by the Virginia Housing Development Authority. The Comprehensive Housing Affordability Strategy will identify housing needs in the Commonwealth; the level of investment and charges to state housing programs necessary to address the need; the availability of state, local, federal, and nongovernmental sources of funds; and the appropriate mix of loans, grants, and other alternative funding methods for implementing the strategy.

APPENDIX A.

§ 36-132. Creation of Department; appointment of Director. There is hereby created in the executive department the Department of Housing and Community Development. The Department shall be headed by a Director who shall be appointed by the Governor, subject to confirmation by the General Assembly, to serve at the pleasure of the Governor for a term coincident with his own.

§ 36-133. Director to supervise Department. The Director of the Department of Housing and Community Development shall, under the direction and control of the Governor be responsible for the supervision of the Department and shall exercise such other powers and perform such other duties as may be required of him by the Governor.

§ 36-134. General powers of Director.

The Director shall have the following general powers:

A. To employ such personnel as may be required to carry out the purposes of this chapter.

B. To make and enter into all contracts and agreements necessary or incidental to the performance of the Department's duties and the execution of its powers under this chapter, including, but not limited to, contracts with the United States, other states, agencies and governmental subdivisions of this Commonwealth.

C. To accept grants from the United States government and agencies and instrumentalities thereof and any other source. To these ends, the Department shall have the power to comply with such conditions and execute such agreements as may be necessary, convenient or desirable.

D. To do all acts necessary or convenient to carry out the purposes of this chapter.

§ 36-135. Board of Housing and Community Development; members; terms; chairman. The Board of Housing and Community Development within the Department of Housing and Community Development shall consist of thirteen members as follows: eleven members, one representing each congressional district in the Commonwealth, who are appointed by the Governor, subject to confirmation by the General Assembly, the Executive Director of the Virginia Housing Development Authority as an ex officio nonvoting member and a member of the Virginia Fire Services Board, to be appointed by the chairman of that Board. Members shall serve for four-year terms and no member shall serve for more than two full successive terms. A chairman of the Board shall be elected annually by the Board.

§ 36-136. Meetings of Board. The Board shall meet at least once every three months, and on the call of the chairman, when, in his opinion, additional meetings are necessary.

§ 36-137. Powers and duties of Board. The Board

shall exercise the following powers and duties, and such others as may be provided by law:

1. Provide a means of citizen access to the Department.

2. Provide a means of publicizing the policies and programs of the Department in order to educate the public and elicit public support for Department activities.

3. Monitor the policies and activities of the Department and have the right of access to departmental information.

4. Advise the Governor and the Director on matters relating to housing and community development.

5. Make such rules and regulations as may be necessary to carry out its responsibilities and repeal or amend such rules when necessary.

6. Issue a certificate of competence concerning the content, application, and intent of specified subject areas of the building and fire regulations promulgated by the Board to present or prospective personnel of local governments and to any other persons seeking to become qualified to perform inspections pursuant to Chapter 6 (§ 36-97 et seq.) of this title and any regulations adopted thereunder, who have completed training programs or in other ways demonstrated adequate knowledge.

7. Levy by regulation up to one percent of building permit fees authorized pursuant to § 36-105 to support training programs of the Building Code Academy established pursuant to § 36-139. Local building departments shall collect such levy and transmit it quarterly to the Department of Housing and Community Development. Localities which maintain, individual or regional, training academies accredited by the Department of Housing and Community Development shall retain such levy. However, such localities may send employees to training programs of the Building Code Academy upon payment of a fee calculated to cover the cost of such training. Any unspent balance shall be reappropriated each year for the continued operation of the Building Code Academy. Annual collections of such levy in excess of \$500,000 or any unobligated fund balance greater than one-third of that year's collections shall be credited against the levy to be collected in the next fiscal year.

8. Establish general policies, procedures, and programs for the Virginia Housing Partnership Revolving Fund established in Chapter 9 (§ 36-141 et seq.) of this title.

9. Determine the categories of housing programs, housing sponsors and persons and families of low and moderate income eligible to participate in grant or loan programs of the Virginia Housing Partnership

Revolving Fund and designate the proportion of such grants or loans to be made available in each category.

10. Advise the Director of the Department on the program guidelines required to accomplish the policies and procedures of the Virginia Housing Partnership Revolving Fund.

11. Advise the Virginia Housing Development Authority on matters relating to the administration and management of loans and grants from the Virginia Housing Partnership Revolving Fund.

12. Establish the amount of the low-income housing credit, the terms and conditions for qualifying for such credit, and the terms and conditions for computing any credit recapture amount for the Virginia income tax return.

13. Serve in an advisory capacity to the Center for Housing Research established by § 23-135.7:14.

14. Advise the Department in the development of the Comprehensive Housing Affordability Strategy to guide and coordinate the housing programs of the Department, the Virginia Housing Development Authority, and other state agencies and instrumentalities.

§ 36-139. Powers and duties of Director.

The Director of the Department of Housing and Community Development shall have the following responsibilities:

1. Collecting from the governmental subdivisions of the Commonwealth information relevant to their planning and development activities, boundary changes, changes of forms and status of government, intergovernmental agreements and arrangements, and such other information as he may deem necessary.

2. Making information available to communities, planning district commissions, service districts and governmental subdivisions of the Commonwealth.

3. Providing professional and technical assistance to, and cooperating with, any planning agency, planning district commission, service district, and governmental subdivision engaged in the preparation of development plans and programs, service district plans, or consolidation agreements.

4. Assisting the Governor in the providing of such state financial aid as may be appropriated by the General Assembly in accordance with § 15.1-1412.

5. Administering federal grant assistance programs, including funds from the Appalachian Regional Commission, the Economic Development Administration and other such federal agencies, directed at promoting the development of the Commonwealth's communities and regions.

6. Developing state community development policies, goals, plans and programs for the consideration and adoption of the Board with the ultimate authority for adoption to rest with the

Governor and the General Assembly.

7. Developing a Comprehensive Housing Affordability Strategy to guide the development and implementation of housing programs in the Commonwealth for the purpose of meeting the housing needs of the Commonwealth and, in particular, those of low-income and moderate-income persons and families.

8. Determining present and future housing requirements of the Commonwealth on an annual basis and revising the Comprehensive Housing Affordability Strategy, as necessary to coordinate the elements of housing production to ensure the availability of housing where and when needed.

9. Assuming administrative coordination of the various state housing programs and cooperating with the various state agencies in their programs as they relate to housing.

10. Establishing public information and educational programs relating to housing; devising and administering programs to inform all citizens about housing and housing-related programs that are available on all levels of government; designing and administering educational programs to prepare families for home ownership and counseling them during their first years as homeowners; and promoting educational programs to assist sponsors in the development of low and moderate income housing as well as programs to lessen the problems of rental housing management.

11. Administering the provisions of the Industrialized Building Safety Law (§ 36-70 et seq.).

12. Administering the provisions of the Uniform Statewide Building Code (§ 36-97 et seq.).

13. Administering the provisions of the Statewide Fire Prevention Code (§ 27-94 et seq.).

14. Establishing and operating a Building Code Academy for the training of personnel in building regulations promulgated by the Board of Housing and Community Development.

15. Administering, in conjunction with the federal government, and promulgating any necessary regulations regarding energy standards for existing buildings as may be required pursuant to federal law.

16. Identifying and disseminating information to local governments about the availability and utilization of federal and state resources.

17. Administering, with the cooperation of the Department of Health, state assistance programs for public water supply systems.

18. Advising the Board on matters relating to policies and programs of the Virginia Housing Partnership Revolving Fund.

19. Designing and establishing program guidelines to meet the purposes of the Virginia Housing Partnership Revolving Fund and to carry out the

APPENDIX A.

policies and procedures established by the Board.

20. Preparing agreements and documents for loans and grants to be made from the Virginia Housing Partnership Revolving Fund; soliciting, receiving, reviewing and selecting the applications for which loans and grants are to be made from such fund; directing the Virginia Housing Development Authority as to the closing and disbursing of such loans and grants and as to the servicing and collection of such loans; directing the Virginia Housing Development Authority as to the regulation and monitoring of the ownership, occupancy and operation of the housing developments and residential housing financed or assisted by such loans and grants; and providing direction and guidance to the Virginia Housing Development Authority as to the investment of moneys in such fund.

21. Advising the Board on matters relating to policies for the low-income housing credit and administering the approval of low-income housing credits as provided in § 36-55.63.

22. Establishing and administering program guidelines for a statewide homeless intervention program.

23. Carrying out such other duties as may be necessary and convenient to the exercise of powers granted to the Department.

§ 36-139.1. Sale of real property for housing demonstration projects. The Director is authorized to sell surplus real property belonging to the Commonwealth which is placed under the control of the Department for the purpose of establishing owner-occupied residential housing demonstration projects, with the prior written approval of the Governor or his designee, who shall first consider the written recommendation of the Director of the Department of General Services. The methods, terms and conditions of sale shall be developed in cooperation with the Department of General Services. Any contract of sale or deed of conveyance shall be approved as to form by the Attorney General or one of his deputies or assistant attorneys general. The proceeds from all such sales shall be handled in the manner prescribed in subsection C of § 2.1-512.

§ 36-139.2. Appointment of State Fire Marshal; qualifications; powers and duties; power to arrest, to procure and serve warrants and to issue summonses; limitation on authority. The Director shall appoint a State Fire Marshal and other personnel necessary to carry out the provisions of the Statewide Fire Prevention Code (§ 27-94 et seq.). The State Fire Marshal and other personnel appointed pursuant to this section shall be selected upon the basis of education or experience in administering laws and regulations designed to prevent and eliminate hazards

to life and property arising from fire.

The State Fire Marshal shall have the powers and duties prescribed by the Statewide Fire Prevention Code (§ 27-94 et seq.), by § 27-61, by Board regulation and by the Director. The State Fire Marshal and those persons duly authorized to enforce the Statewide Fire Prevention Code shall have the authority to arrest, to procure and serve warrants of arrests and to issue summonses in the manner authorized by general law for violation of the Statewide Fire Prevention Code. The authority granted in this section shall not be construed to authorize the State Fire Marshal to wear or carry firearms. All personnel appointed pursuant to this section shall meet the training requirements set forth for local fire marshals in § 27-34.2.

§ 36-139.3. Inspection of residential care facilities operated by state agencies; enforcement of safety standards. Notwithstanding any other provisions of this chapter, the State Fire Marshal, upon presenting appropriate credentials, is empowered to and shall make annual inspections for hazards incident to fire in all residential care facilities operated by any state agency and in all adult care residences licensed or subject to licensure pursuant to Chapter 9 (§ 63.1-172 et seq.) of Title 63.1. In the event that any such facility or residence is found to be nonconforming to the Statewide Fire Prevention Code (§ 27-94 et seq.), the State Fire Marshal may petition any court of competent jurisdiction for the issuance of an injunction.

§ 36-139.4. Agreements between Department and other agencies. The Department is hereby authorized to enter into agreements with federal agencies, other state agencies and political subdivisions for services directly related to enforcement and administration of laws, rules, or regulations, or ordinances of such agencies affecting fire safety in public buildings.

APPENDIX B.

EXCERPT FROM THE VIRGINIA CERTIFICATION STANDARDS. BLASTER CERTIFICATION. PART IV.

§ 4.1. **Exemption from certification.** Individuals conducting agricultural blasting operations on their own property are not required to be certified as a blaster.

§ 4.2. **Certification.** Certification shall be in the following two classifications:

1. **Unrestricted blaster.** A person classified as a certified unrestricted blaster shall be qualified to conduct appropriate blasting without limit as to size of shot or type of detonation devices. An applicant for unrestricted blaster certification shall successfully complete an examination developed and administered by a recognized and approved testing agency listed in Appendix A.

2. **Restricted blaster.** A person classified as a certified restricted blaster shall be qualified to conduct blasting operations involving five pounds of explosives or less per shot and use only instantaneous blasting caps. An applicant for restricted blaster certification shall successfully complete an examination developed and administered by a recognized and approved testing agency listed in Appendix A.

§ 4.3. **Qualifications of candidates.** An applicant for a blaster's certification shall meet the following criteria:

1. Be at least 21 years of age;
2. Be able to understand and give written and oral instructions in the English language;
3. a. For unrestricted blaster certification, have worked at least one year under the direct supervision of a blaster certified by the Commonwealth of Virginia or another authority recognized by the Department of Housing and Community Development;
- b. For restricted blaster certification, have worked at least one year under the direct supervision of an individual certified as an unrestricted blaster or as a restricted blaster by the Commonwealth of Virginia or another
Housing and Community Development.

NOTE: In no case shall a certified restricted blaster's supervision be acceptable for an unrestricted blaster's experience requirements.

4. Have a working knowledge of federal, state, and local laws and regulations pertaining to explosive materials.

§ 4.4. **Temporary certification.** A temporary certificate may be issued to any person who meets the applicant criteria listed in § 4.3. Any temporary certificate issued shall expire 12 months from the date of issuance. Temporary certifications shall not be renewed.

§ 4.5. **Renewal.** A blasters certificate shall be renewed every three years from date of issuance. As a condition of renewal, proof of continued training or education in the use of explosives in an amount not less than 16 hours in 3 consecutive years shall be provided to the department. Requests for renewal shall be submitted on forms provided by the department.

§ 4.6. **Revocation or suspension of certification.** The Department of Housing and Community Development may revoke or suspend certification issued under the provisions of this regulation if conditions of the certification have been violated, or if there has been any false statement or misrepresentation in the application on which the certification was based or for incompetence as demonstrated by flagrant and repeated violations of the VSFPC, or participating in three or more incidents within a five-year period resulting in property damage, injury or death.

§ 4.7. **Appeals.** Any person aggrieved by a decision based upon application of this certification standard may appeal that decision, in writing, directly to the State Building Code Technical Review Board in accordance with the appeals process outlined in § 116.0 of the Virginia Uniform Statewide Building Code, Volume I.

APPENDIX C.

PREVIOUS ADOPTIONS AND AMENDMENTS.

The Virginia Uniform Statewide Building Code (USBC) was first adopted in 1973 by the State Board of Housing. Responsibility for the USBC passed to the State Board of Housing and Community Development on July 1, 1978. The initial adoption and subsequent amendments by these Boards are indicated below:

* **1973 Edition**

Effective date: September 1, 1973

Title: Virginia Uniform Statewide Building Code, Administrative Amendments, 1973 Edition

Major reference standards:

BOCA Basic Building Code/1970, with 1972 Accumulative Supplement

BOCA Basic Mechanical Code/1971

BOCA Basic Plumbing Code/1970, with 1972 Accumulative Supplement

NFiPA National Electrical Code/1971

One and Two Family Dwelling Code/1971

* **1974 Accumulative Supplement**

Effective date: April 1, 1974

Title: 1974 Accumulative Supplement to Virginia Uniform Statewide Building Code

Major reference standards:

BOCA Basic Building Code/1970, with 1972 Accumulative Supplement

BOCA Basic Mechanical Code/1971

BOCA Basic Plumbing Code/1970, with 1972 Accumulative Supplement

NFiPA National Electrical Code/1971

* **1975 Accumulative Supplement**

Effective date: February 7, 1976

Title: 1975 Accumulative Supplement to Virginia Uniform Statewide Building Code

Major reference standards:

BOCA Basic Building Code/1975

BOCA Basic Mechanical Code/1975

BOCA Basic Plumbing Code/1975

NFiPA National Electrical Code/1975

One and Two Family Dwelling Code/1975

* **1978 Accumulative Supplement**

Effective date: August 1, 1978

Title: 1978 Accumulative Supplement to Virginia Uniform Statewide Building Code

Major reference standards:

BOCA Basic Building Code/1978

BOCA Basic Mechanical Code/1978

BOCA Basic Plumbing Code/1978

NFiPA National Electrical Code/1978

One and Two Family Dwelling Code/1975

* **1978 Accumulative Supplement (First Amendment)**

Effective date: January 1, 1981

NOTE: The 1978 Accumulative Supplement to the Virginia Uniform Statewide Building Code was continued, but with a few changes to the previously referenced BOCA Basic Building Code/1978.

- * **1981 Edition**
Effective date: July 16, 1982
Title: Virginia Uniform Statewide Building Code, 1981 Edition
Major reference standards:
 - BOCA Basic Building Code/1981
 - BOCA Basic Mechanical Code/1981
 - BOCA Basic Plumbing Code/1981
 - NFiPA National Electrical Code/1981
 - One and Two Family Dwelling Code/1979 with 1980 Amendments

- * **1981 Edition (First Amendment)**
Effective date: June 20, 1984
Title: Sections 515.4 and 515.5 of Article 5 of the 1981 Edition, Virginia Uniform Statewide Building Code

- * **1984 Edition**
Effective date: April 1, 1986
Title: Virginia Uniform Statewide Building Code, Volume I - New Construction Code, 1984 Edition
Major reference standards:
 - BOCA Basic Building Code/1984
 - BOCA Basic Mechanical Code/1984
 - BOCA Basic Plumbing Code/1984
 - NFiPA National Electrical Code/1984
 - One and Two Family Dwelling Code/1983 with 1984 Amendments

- * **1987 Edition**
Effective date: March 1, 1988
Title: Virginia Uniform Statewide Building Code, Volume I - New Construction Code, 1987 Edition
Major reference standards:
 - BOCA Basic Building Code/1987
 - BOCA Basic Mechanical Code/1987
 - BOCA Basic Plumbing Code/1987
 - NFiPA National Electrical Code/1987
 - One and Two Family Dwelling Code/1986 with 1987 Amendments

- * **1987 Edition (First Amendment)**
Effective date: March 1, 1989
Title: Virginia Uniform Statewide Building Code, Volume I - New Construction Code, 1987 Edition
Major reference standards: Same as 1987 Edition

- * **1987 Edition (Second Amendment)**
Effective date: March 1, 1990
Title: Virginia Uniform Statewide Building Code, Volume I - New Construction Code, 1987 Edition
Major reference standards: Same as 1987 Edition

APPENDIX C.

* **1987 Edition (Third Amendment)**

Effective date: October 1, 1990

Title: Virginia Uniform Statewide Building Code, Volume I - New Construction Code, 1987 Edition

Major reference standards: Same as 1987 Edition

* **1990 Edition**

Effective date: March 1, 1991

Title: Virginia Uniform Statewide Building Code, Volume I - New Construction Code, 1990 Edition

Major reference standards:

BOCA National Building Code/1990

BOCA National Mechanical Code/1990

BOCA National Plumbing Code/1990

NFiPA National Electrical Code/1990

CABO One & Two Family Dwelling Code/1989 with 1990 Amendments

* **1990 Edition (First Amendment)**

Effective date: November 1, 1991

Title: Virginia Uniform Statewide Building Code, Volume I - New Construction Code, 1990 Edition - First Amendment

Major reference standards: Same as 1990 Edition.

* **1990 Edition (Second Amendment)**

Effective date: February 1, 1992

Title: Virginia Uniform Statewide Building Code, Volume I - New Construction Code, 1990 Edition - Second Amendment

Major reference standards: Same as 1990 Edition.

* **1990 Edition (Third Amendment)**

Effective date: March 1, 1993

Title: Virginia Uniform Statewide Building Code, Volume I - New Construction Code, 1990 Edition - Third Amendment

Major reference standards: Same as 1990 Edition

APPENDIX D.

BOARD OF HOUSING AND COMMUNITY DEVELOPMENT

Mr. Leonard S. Hobie Mitchel
Chairman

Mr. Pablo Cuevas
Vice Chairman

Mr. H. Richard Ashe

Mr. John H. Clements, Sr.

Ms. Jane D. Dittmar

Mr. Oliver P. Farinholt

Ms. Inez Fleming

Mr. Rafael L. Franchi

Mr. Fred Grohgan Jr.

Mr. Richard Harris
Fire Services Board Liaison

Mr. H. Ronnie Montgomery

Mr. Gordan F. Rainey, Jr.

Ex Officio Member

Mr. John Ritchie, Jr.
Virginia Housing Development Authority

Secretary (Non-member)

Mr. Warren C. Smith, Director
Department of Housing and
Community Development

APPENDIX E.

STATE BUILDING CODE TECHNICAL REVIEW BOARD

Mr. Gregory H. Revels
Chairman

Mr. Michael A. Conner, Sr., CPCA
Vice Chairman

Mr. Jeffrey W. Ainslie

Mr. Irvin N. Bennett, Jr.

Mr. Marvin J. Cantor, FAIA

Mr. Dennis B. Clark

Mr. J.C. Hawkins

Mr. W.O. Jones, III

Mr. R. Schaefer Oglesby

Ms. Anne S. Pierce

Mr. Eunice L. Taylor

Secretary (Non-member)

Mr. Norman R. Crumpton, CPCA
Associate Director, DHCD

APPENDIX F.

FORMS AVAILABLE.

The State Building Code Office has certain forms available to assist users of building, fire and related regulations promulgated by the BHCD and copies may be obtained from:

State Building Code Office
Department of Housing and Community Development
501 North Second Street
Richmond, Virginia 23219-1321
Telephone: (804) 371-7170
Facsimile:(804) 371-7092

Forms available for proposed changes to:

1. BOCA Model Codes
2. CABO Standard
3. NEC Standard
4. BHCD Regulations